


































LEGEND AND MATERIAL LIST		
SYMBOL	DESCRIPTION	FIGURE
	EMERGENCY ESCAPE SIGNAGE – GO STRAIGHT	
	EMERGENCY ESCAPE SIGNAGE – TURN RIGHT	
	EMERGENCY ESCAPE SIGNAGE – TURN LEFT	
	EMERGENCY ESCAPE SIGNAGE – FINAL EXIT	
	PANIC HARDWARE ON EXIT ACCESS AND/OR EXT. DOOR	—
	2X20W EMERGENCY LIGHTING FIXTURE	—
	2X20W EMERGENCY LIGHTING FIXTURE (WEATHER PROOF)	—
	6W EMERGENCY LIGHTING FIXTURE	—
	DISTRIBUTION PANEL	—
	EMERGENCY LIGHTING FIXTURE CABLING (3X2,5mm2 NHXMH)	—
	FIRE BARRIER WALL (120 MIN.)	—
	FIRE BARRIER WALL (60 MIN.WALL, 45 MIN.DOOR)	—
	FIRE BARRIER WALL (60 MIN.WALL,30 MIN. DOOR)	—
	FIRE RESISTANCE RATING INDICATION OF DOORS	—






NOTES

- 1- Pictographs which shall be used for exit signs, shall be suitable to Europe norms (EN).
- 2- Pictographs which shall be used for exit signs, shall be suitable to EN ISO 7010 & ISO 3864 standards.
- 3- Exit signs shall be continuous, self illuminated and have at least 2 hour battery.
- 4- Emergency lighting shall be provided on the main means of egress paths.
- 5- Exit signs, barrier arrangements shall be provided in fire escape stairs to lead occupants to evacuate the floor.

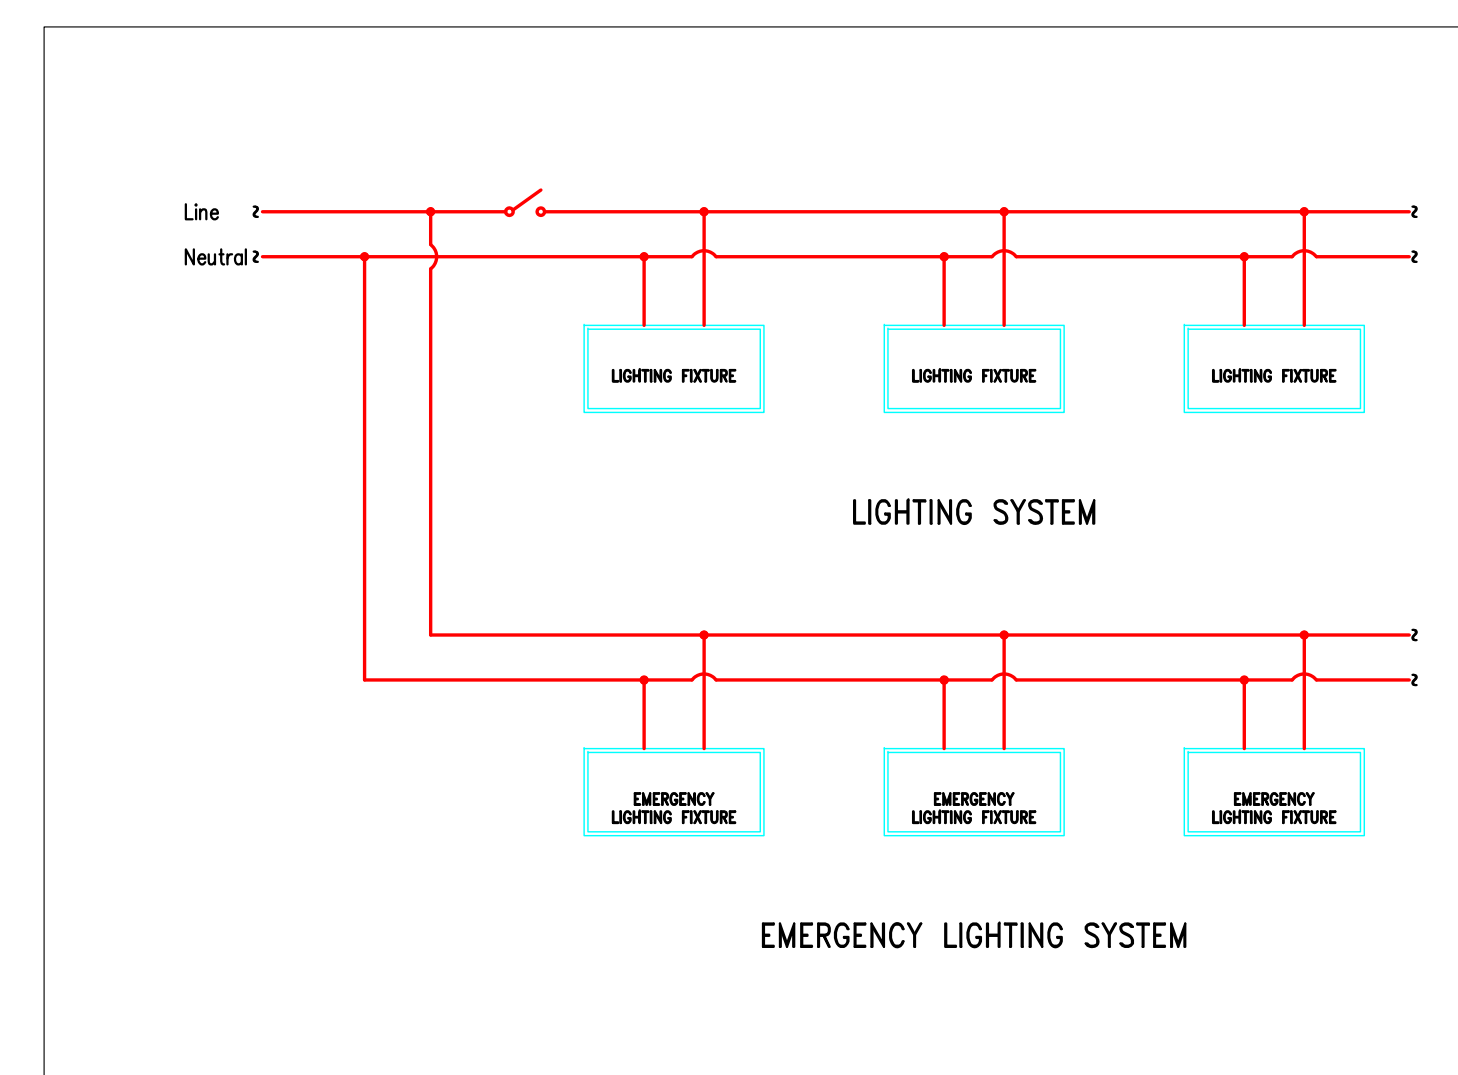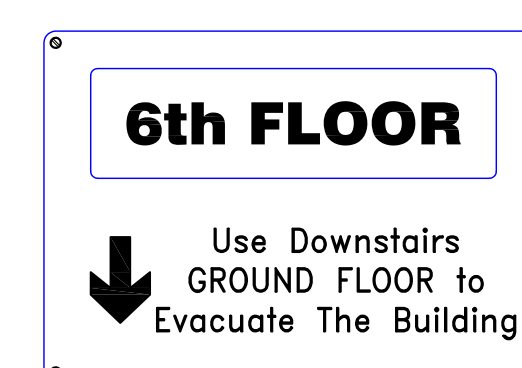









EXIT SIGNAGE INSTALLATION DISTANCES  
(NOT TO SCALE)



EMERGENCY EXIT FIXTURE INSTALLATIONS  
(NOT TO SCALE)

EMERGENCY DIRECTIONING SIGN TYPES AND MEANINGS  
(NOT TO SCALE)

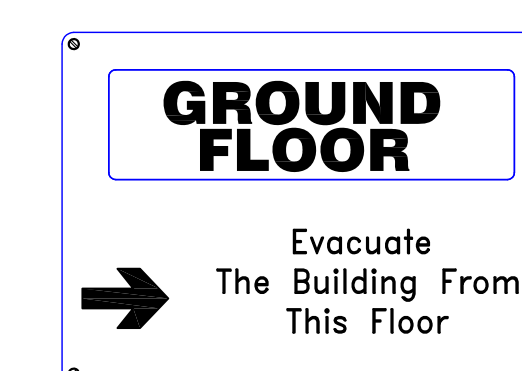

SIGNAGE FOR LEAVING THE EXIT

	<input checked="" type="checkbox"/> FOR SYSTEM APPROVAL <input type="checkbox"/> FOR TENDER <input type="checkbox"/> FOR INSTALLATION <input type="checkbox"/> AS BUILT
KEY PLAN	
DO	15.10.2020 For System Approval
Date	Explanation
CLIENT	
<b>EVEX GEORGIA HEATHCARE GROUP</b> 40 Vasho Palatashvili Ave Tbilisi – GEORGIA Tel: +995 322 55 05 05	
DESIGNER	
<b>TASARIM, DANIŞMANLIK VE EĞİTİM HİZMETLERİ LTD.ŞTİ.</b> Çeşitli EMEC Binaları 2. Cad. No : 37/A A. ÖZGELER – 06460 ANKARA / TÜRKİY Tel : +90-312-472 62 88      Faks : +90-312-472 62 89      e-posta: info@karina.gen.tr	
TECH. CONSULTANCY : <b>KARİNA</b>  SYSTEM DESIGN : <b>KARİNA</b>  MATERIAL SUPPLY : –  INSTALLATION : –  APPROVAL : –  DATE : 15.10.2020  SCALE : 1/200	<b>SUNSTONE HOSPITAL</b>  FIRE & LIFE SAFETY LFS02.1 MEANS OF EGRESS ILLUMINATION & LFS02.2 MEANS OF EGRESS ILLUMINATED EXIT MARKING SIGNS, PLAN DRAWING LEGEND, GENERAL NOTES & DETAILS  <div style="display: flex; justify-content: space-between; align-items: center;"> <div style="text-align: center;">               CAB           </div> <div style="border: 1px solid black; padding: 5px; flex-grow: 1;">             DRAWING NO <b>EVEX-SNST-KAR-100</b> </div> <div style="text-align: right;">             REV. <b>00</b>              * / *           </div> </div>

