


① DEMOLITION PLAN – SECOND FLOOR #207-AR-001
1/100

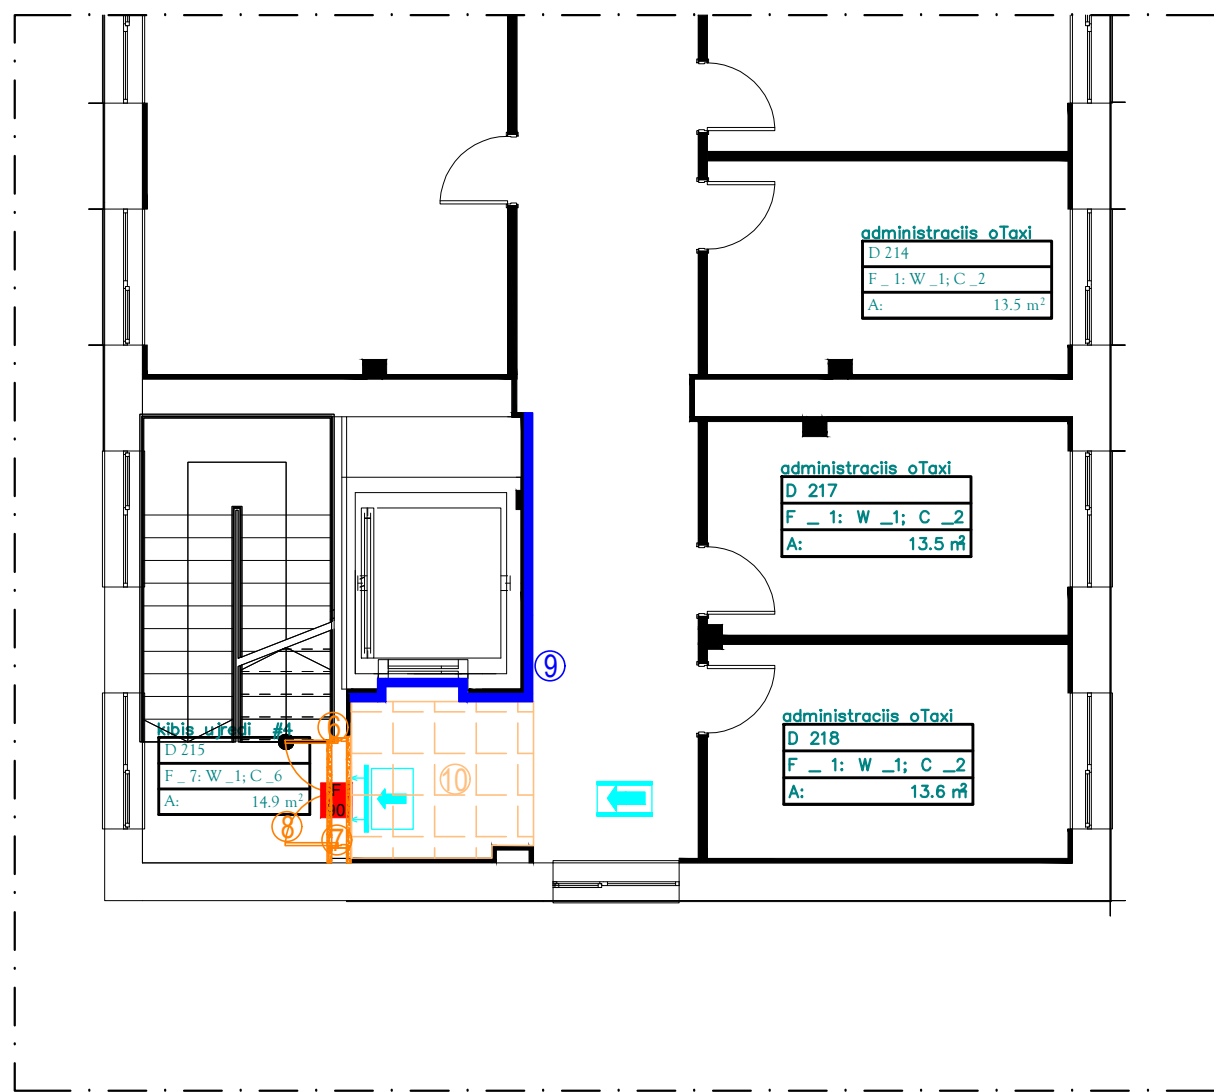

② NEW CONSTRUCTION PLAN –SECOND FLOOR #207-AR-001
1/100

- Demolition of equipment on the ceiling
 - 1 60*60 led lighting fixture
 - 1 smoke detector
 - 1 Ø20 culvert
 - 1 Ø20 culvert
 - 1 Ø250 flexible duct(4m)
 - 1 45*30 culvert
- Demolition of grid suspended ceiling– total 5.1m2
- Demolition of equipment on the walls which surrounds the elevator and the staircase wall
 - 1 double switch
 - 1 elevator control panel
 - 1 audio-visual device
 - 1 fire button
- Demolition of the existing fire staircase door(140*210cm)
- Demolition of plasterboard above and next to the door from the both sides of the wall, as seen in the elevation view. (2X60*140cm)
- Construction of EI120 fire wall: Mounting EI120 plasterboards from the both sides of the wall (2X75*140cm) and rockwool filling, see staircase wall detail no:5.
- Filling the existing threshold, ensuring a smooth passage to the fire staircase without any obstruction.
- Providing a new EI90 fire door with panic bar(140*210cm) (there shall not be a threshold)
- Construction of EI60 fire wall surrounding of the elevator:Mounting of EI60 plasterboards (2x15 mm manufactured from one side) over the existing wall–without dismantling of it–to the walls which surrounds the elevator, see elevator shaft wall detail no:4.
 - 6.57m length and 2.80m height
- Mounting new grid suspended ceiling.
- Reassembling the dismantled equipment on ceiling and wall.
- Repairing of vinly tiling on the floor of the parts which are damaged while demolishing the walls.


LEGEND AND MATERIAL LIST	
SYMBOL	DESCRIPTION
	TO BE DEMOLISHED 60*60 GRID SUSPENDED CEILING
	TO BE MOUNTED 60*60 GRID SUSPENDED CEILING
	TO BE DEMOLISHED PVC HYGENIZC SUSPENDED CEILING
	TO BE MOUNTED PVC HYGENIZC SUSPENDED CEILING
	TO BE DEMOLISHED PLASTERBOARD SUSPENDED CEILING
	TO BE MOUNTED PLASTERBOARD SUSPENDED CEILING
	TO BE CLOSED HOLE BY BMS WALL
	TO BE DEMOLISHED EXISTING PLASTERBOARD WALL
	TO BE DEMOLISHED EXISTING CERAMIC TILE
	TO BE CONSTRUCTED PLASTERBOARD WALL WITHOUT FIRE RATING
	TO BE CONSTRUCTED CERAMIC TILE
	TO BE CONSTRUCTED COMPARTMENT WALL FOR FIRE SEPARATION EI60– 2x12,5 mm /from both sides
	TO BE CONSTRUCTED SHAFT WALL FOR FIRE SEPARATION EI120 – Shaft Wall 2x25 mm Flameboard/from one side
	TO BE CONSTRUCTED WALL FOR FIRE SEPARATION EI120 – 2x15 mm/from both sides
	TO BE CONSTRUCTED WALL FOR FIRE SEPARATION EI60 – 2x15 mm Plasterboard/from one side
	TO BE CONSTRUCTED HALL WALL FOR FIRE SEPARATION EI60 – One Layer
	TO BE DEMOLISHED EXISTING DOOR
	TO BE MOUNTED NEW FIRE DOOR
	TO BE REMOUNTED EXISTING DOOR




(Existing fire staircase door and wall)




③ PHOTOGRAPHS OF CURRENT SITUATION – SECOND FLOOR #207-AR-001



④ SHAFT WALL DETAIL FOR FIRE SEPARATION EI60/from one side



⑤ STAIRCASE WALL DETAIL FOR FIRE SEPARATION EI120/from both sides



⑥ ELEVATION VIEW OF FIRE STAIRCASE DOOR
1/50

<input checked="" type="checkbox"/> FOR SYSTEM APPROVAL <input type="checkbox"/> FOR TENDER <input type="checkbox"/> FOR INSTALLATION <input type="checkbox"/> AS BUILT		
KEY PLAN		
For System Approval		
Date	Explanation	
CLIENT 		
DESIGNER TASARIM, DANIŞMANLIK VE EĞİTİM HİZMETLERİ LTD.ŞTİ. Cetin EMEC Bulvarı 2. Cad. No : 37/4 A. ÖVEÇLER – 06460 ANKARA / TÜRKİYE Tel : +90-312-472 62 88 Faks : +90-312-472 62 89 e-posta: info@karina.gen.tr		
TECH. CONSULTANCY : KARİNA	FIRE & LIFE SAFETY IMPROVEMENT OF FIRE& SMOKE COMPARTMENT FEATURES DRAWINGS	
SYSTEM DESIGN : KARİNA		
MATERIAL SUPPLY : –		
INSTALLATION : –		
APPROVAL : –		
DATE : 08.11.2020	DRAWING NO : EVEX-SNS-KAR-207-AR-001	REV. 00 */
SCALE : 1/100	FILE NAME : C:\EVEX-SNS-KAR-204-205-206-207.*	