

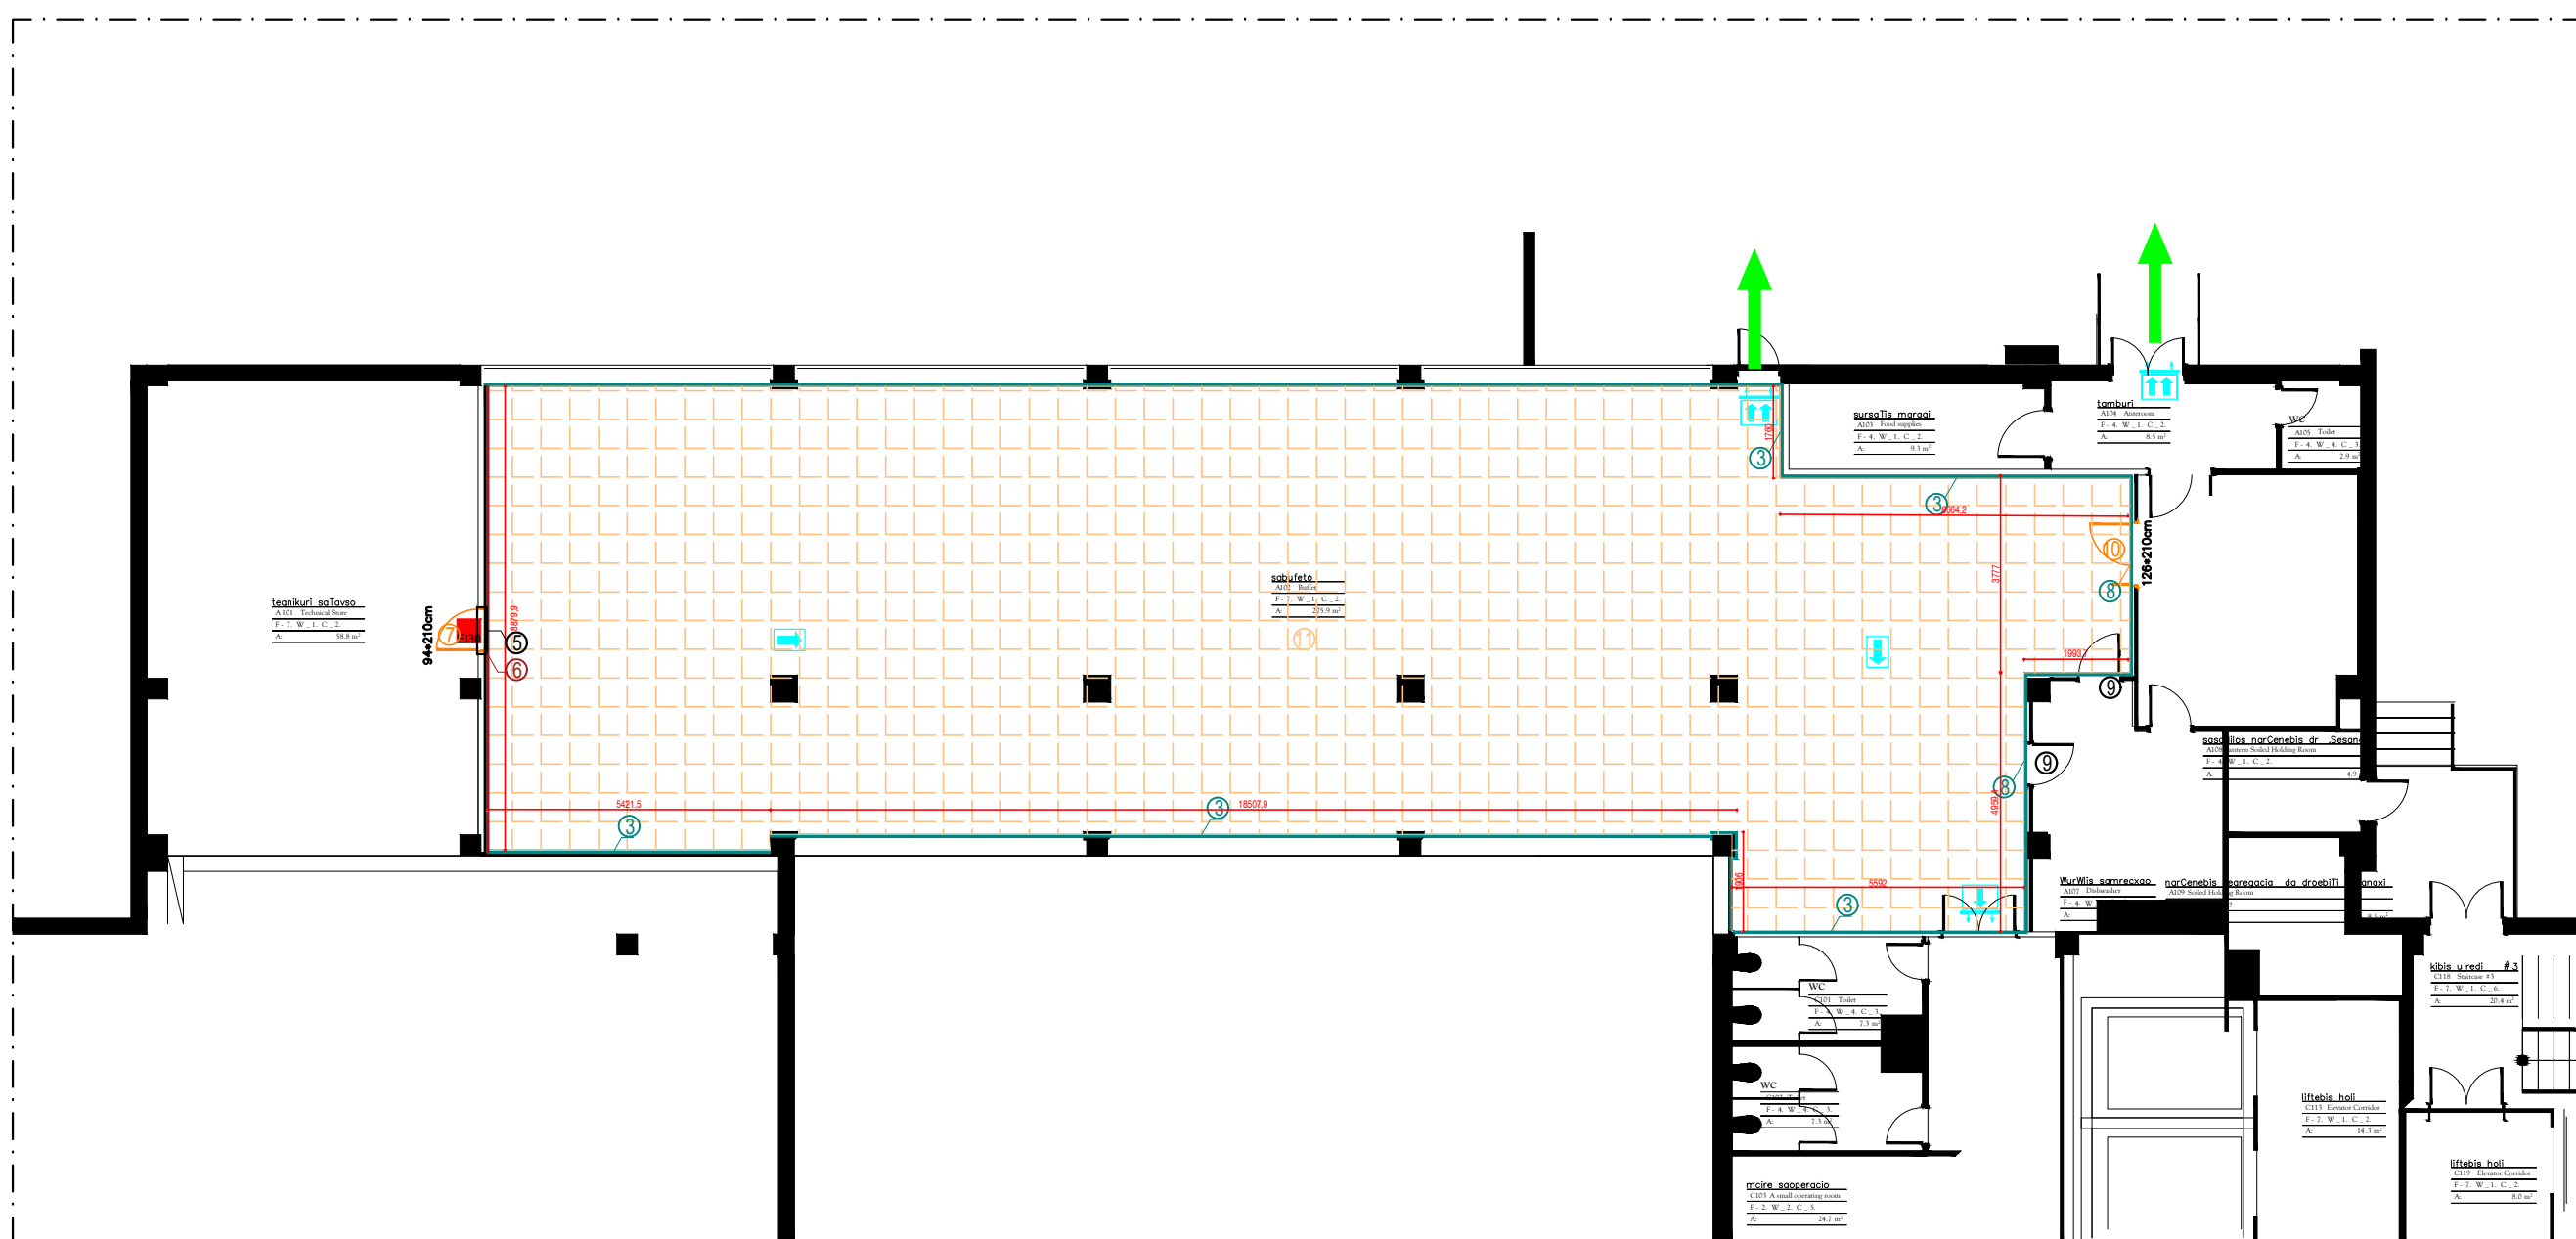


① DEMOLITION PLAN – FIRST FLOOR MEDICAL SUPPLY ROOM #101-AR-001
1/100




② NEW CONSTRUCTION PLAN – FIRST FLOOR MEDICAL SUPPLY ROOM #101-AR-001
1/100


- Demolition of the equipment on the ceiling
- Demolition of grid suspended ceiling-263.9m²
- There already exists one layer of plasterboard, but it does not continue up to the ceiling, so 10cm height space between the existing plasterboard wall and ceiling will be closed by mounting one layer of plasterboard above the existing one (559*10cm,190*10cm,176*10cm,1850*10cm,542*10cm,176*10cm,666*10cm)
- Demolition of the existing door of AHU room(94*210cm)
- Apply fire stopping to the hole above the door(94*20cm)
- Mounting one layer of 15mm EI60 plasterboard to the wall of AHU room within the door from the room(880*270cm)
- Provide a new EI30 door for AHU room (94*210cm)
- There already exists one layer of plasterboard, but it does not continue up to the ceiling, so 60cm height space between the existing plasterboard wall and ceiling will be closed by mounting one layer of plasterboard above the existing one (495*60cm,199*60cm,377*60cm)
- Change the door lock of two doors
- Provide a new double-leaf door (126*210cm)
- Mounting of grid suspended ceiling-10.8m²
- Reassemble of the equipments on the ceiling-263.9m²



③ PHOTOGRAPHS OF CURRENT SITUATION –FIRST FLOOR MEDICAL SUPPLY ROOM #101-AR-001



④ ELEVATION VIEW OF AHU ROOM – FIRST FLOOR MEDICAL SUPPLY ROOM #101-AR-001
1/50



⑤ WALL DETAIL FOR FIRE SEPARATION EI60/

LEGEND AND MATERIAL LIST	
SYMBOL	DESCRIPTION
[Symbol]	TO BE DEMOLISHED 60x60 GRID SUSPENDED CEILING
[Symbol]	TO BE MOUNTED 60x60 GRID SUSPENDED CEILING
[Symbol]	TO BE DEMOLISHED PVC HYGIENIC SUSPENDED CEILING
[Symbol]	TO BE MOUNTED PVC HYGIENIC SUSPENDED CEILING
[Symbol]	TO BE DEMOLISHED PLASTERBOARD SUSPENDED CEILING
[Symbol]	TO BE MOUNTED PLASTERBOARD SUSPENDED CEILING
[Symbol]	TO BE CLOSED HOLE BY IRMS WALL
[Symbol]	TO BE APPLIED FIRE STOPPING AT THE FLOOR LEVEL WITH ADDITIONAL SUPPORTING CONSTRUCTION
[Symbol]	TO BE DEMOLISHED EXISTING PLASTERBOARD WALL
[Symbol]	TO BE DEMOLISHED EXISTING GLASS PARTITION WALL
[Symbol]	TO BE DEMOLISHED EXISTING CERAMIC TILE
[Symbol]	TO BE CONSTRUCTED PLASTERBOARD WALL WITHOUT FIRE RATING
[Symbol]	TO BE CONSTRUCTED CERAMIC TILE
[Symbol]	TO BE CONSTRUCTED COMPARTMENT WALL FOR FIRE SEPARATION EI90- 2x12.5 mm /from both sides
[Symbol]	TO BE CONSTRUCTED SHUT WALL FOR FIRE SEPARATION EI150 - Shut Wall 2x25 mm Plasterboard/From one side
[Symbol]	TO BE CONSTRUCTED WALL FOR FIRE SEPARATION EI90 - 2x15 mm/From both sides
[Symbol]	TO BE CONSTRUCTED WALL FOR FIRE SEPARATION EI90 - 2x15 mm Plasterboard/From one side
[Symbol]	TO BE CONSTRUCTED PLASTERBOARD WALL -ABOVE THE EXISTING WALL
[Symbol]	TO BE CONSTRUCTED PLASTERBOARD WALL FOR FIRE SEPARATION EI90 - One Layer
[Symbol]	TO BE CONSTRUCTED 25mm PLASTERBOARD WALL FOR FIRE SEPARATION EI150- One Layer
[Symbol]	TO BE CONSTRUCTED 15mm PLASTERBOARD WALL FOR FIRE SEPARATION EI30- One Layer
[Symbol]	TO BE APPLIED PLASTER
[Symbol]	TO BE DEMOLISHED EXISTING DOOR
[Symbol]	TO BE MOUNTED NEW FIRE DOOR
[Symbol]	TO BE REMOUNTED EXISTING DOOR

<input type="checkbox"/> FOR SYSTEM APPROVAL <input type="checkbox"/> FOR TENDER <input type="checkbox"/> FOR INSTALLATION <input type="checkbox"/> AS BUILT	
KEY PLAN	
Date	For System Approval Explanation
CLIENT	
 EVEX GEORGIA HEALTHCARE GROUP 40 Vahit Paşaoğlu Ave Taksim - GEORGIA Tel: +995 322 35 05 05	
DESIGNER	
 TASARIM, DANIŞMANLIK VE EĞİTİM HİZMETLERİ LTD.ŞTİ. Ceth EMEC Bulvarı 2. Cad. No : 37/4 A. ÖVEÇLER - 06460 ANKARA / TURKEY Tel : +90-312-472 62 68 Faks : +90-312-472 62 69 e-posta: info@karina.gen.tr	
TECH. CONSULTANCY : KARINA	
SYSTEM DESIGN : KARINA	
MATERIAL SUPPLY : -	
INSTALLATION : -	
APPROVAL : -	
DATE : 06.03.2021	
SCALE : 1/100	
DRAWING NO : EVEX-DEKA-KAR-101-AR-001	
FILE NAME : C:\EVEX-DEKA-KAR-101-102-103-104-105\	
FIRE & LIFE SAFETY-05 IMPROVEMENT OF FIRE & SMOKE CONFINEMENT FEATURES DRAWINGS	
REV. 00	