


1 DEMOLITION PLAN - THIRD FLOOR #301-AR-001
1/100




2 NEW CONSTRUCTION PLAN - THIRD FLOOR #301-AR-001
1/100

1. Demolition of the existing door of the fire staircase (150x210cm)
2. Demolition of the plasterboard wall around the door (150x55cm, 65x265cm, 65x265cm)
3. Provide a new double-leaf EI90 door which opens in the direction of egress for the fire staircase (150x210cm)
4. Mounting of two layers of 25mm plasterboards from inside of the staircase to construct EI120 wall.
5. Demolition of the existing door which opens to the outside (150x255cm)
6. Provide a new double-leaf door which opens in to the outside (150x255cm)




4 PHOTOGRAPHS OF CURRENT SITUATION - THIRD FLOOR #301-AR-001




3 WALL DETAIL FOR FIRE SEPARATION EI120/from one side

LEGEND AND MATERIAL LIST	
SYMBOL	DESCRIPTION
	TO BE DEMOLISHED 60x60 GRS SUSPENDED CEILING
	TO BE MOUNTED 60x60 GRS SUSPENDED CEILING
	TO BE DEMOLISHED PVC HYGIENIC SUSPENDED CEILING
	TO BE MOUNTED PVC HYGIENIC SUSPENDED CEILING
	TO BE DEMOLISHED PLASTERBOARD SUSPENDED CEILING
	TO BE MOUNTED PLASTERBOARD SUSPENDED CEILING
	TO BE CLOSED HOLE BY IRMS WALL
	TO BE APPLIED FIRE STOPPING AT THE FLOOR LEVEL WITH ADDITIONAL SUPPORTING CONSTRUCTION
	TO BE DEMOLISHED EXISTING PLASTERBOARD WALL
	TO BE DEMOLISHED EXISTING GLASS PARTITION WALL
	TO BE DEMOLISHED EXISTING CERAMIC TILE
	TO BE DEMOLISHED PLASTERBOARD WALL WITHOUT FIRE RATING
	TO BE DEMOLISHED CERAMIC TILE
	TO BE CONSTRUCTED COMPARTMENT WALL FOR FIRE SEPARATION EI90 - 2x12.5 mm /from both sides
	TO BE CONSTRUCTED SHUTT WALL FOR FIRE SEPARATION EI120 - Shutt Wall 2x25 mm Plasterboard/From one side
	TO BE CONSTRUCTED WALL FOR FIRE SEPARATION EI90 - 2x15 mm/From both sides
	TO BE CONSTRUCTED WALL FOR FIRE SEPARATION EI90 - 2x15 mm/From one side
	TO BE CONSTRUCTED PLASTERBOARD WALL -ABOVE THE EXISTING WALL
	TO BE CONSTRUCTED PLASTERBOARD WALL FOR FIRE SEPARATION EI90 - One Layer
	TO BE CONSTRUCTED 25MM PLASTERBOARD WALL FOR FIRE SEPARATION EI120- One Layer
	TO BE CONSTRUCTED 15MM PLASTERBOARD WALL FOR FIRE SEPARATION EI120- One Layer
	TO BE APPLIED PLASTER
	TO BE DEMOLISHED EXISTING DOOR
	TO BE MOUNTED NEW FIRE DOOR
	TO BE REMOUNTED EXISTING DOOR




1 DEMOLITION PLAN - THIRD FLOOR #301-AR-002
1/100

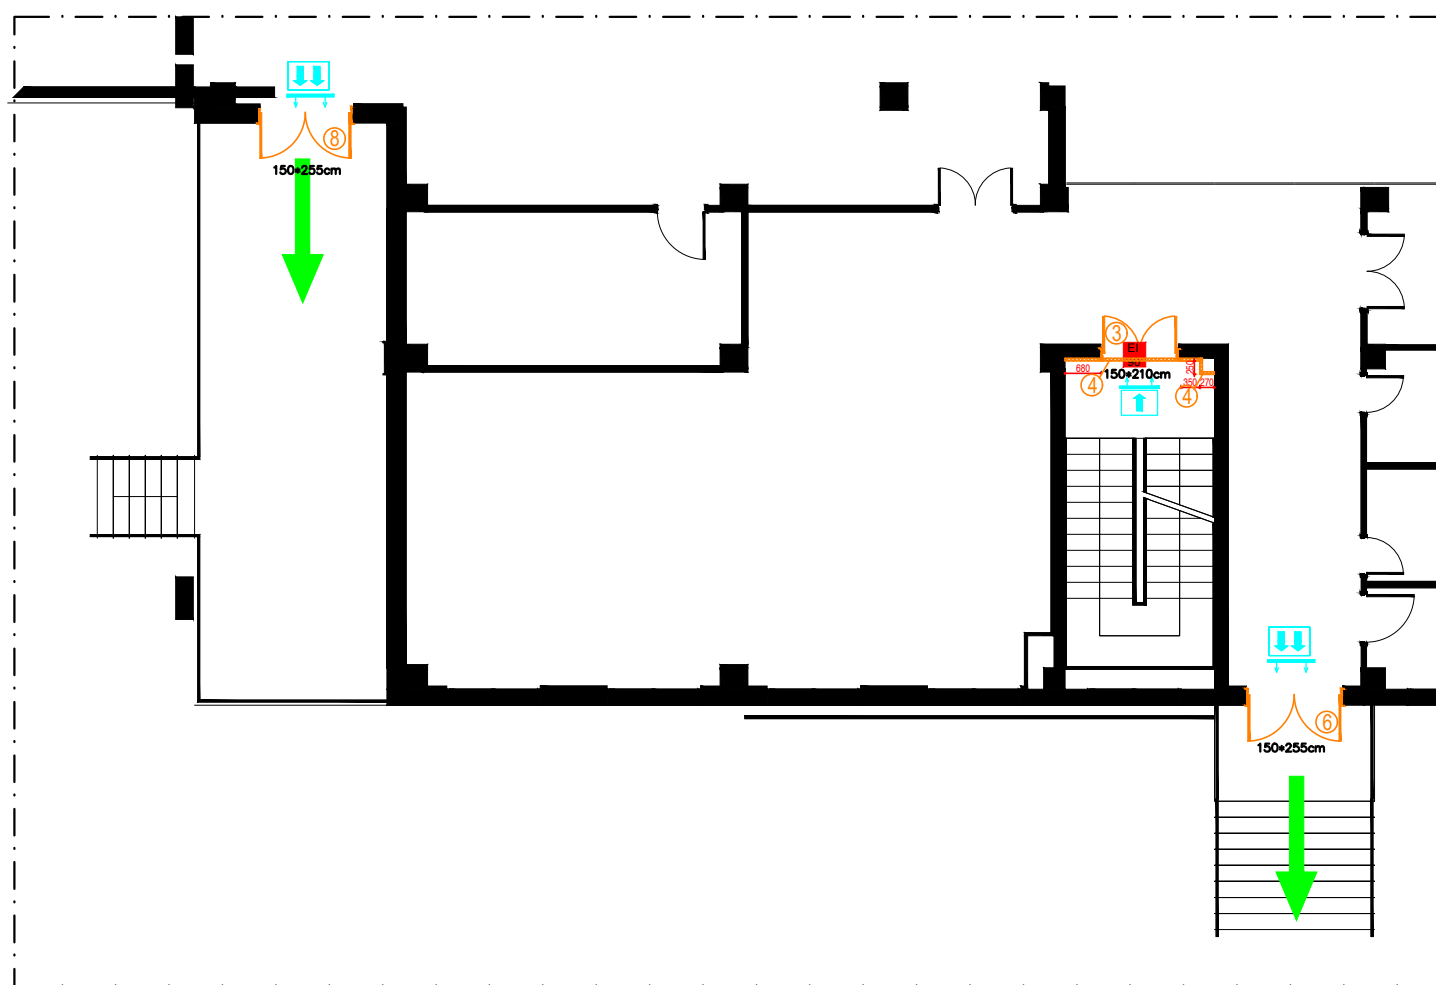


2 NEW CONSTRUCTION PLAN - THIRD FLOOR #301-AR-002
1/100


1. Demolition of the existing door of the fire staircase (150x210cm)
2. Demolition of the plasterboard wall around the door (68x265cm, 150x115cm, 35x265cm, 25x265cm, 27x265cm)
3. Provide a new double-leaf EI90 door which opens in the direction of egress for the fire staircase (150x210cm)
4. Mounting of two layers of 25mm plasterboards from inside of the staircase to construct EI120 wall (68x265cm, 150x115cm, 35x265cm, 25x265cm, 27x265cm)
5. Demolition of the existing door which opens to the outside (150x255cm)
6. Provide a new double-leaf door which opens in to the outside (150x255cm)
7. Demolition of the existing door which opens to the outside (150x255cm)
8. Provide a new double-leaf door which opens in to the outside (150x255cm)



4 PHOTOGRAPHS OF CURRENT SITUATION -THIRD FLOOR #301-AR-002



3 WALL DETAIL FOR FIRE SEPARATION EI120/from one side



For System Approval

Date Explanation

CLIENT EVEX GEORGIA HEALTHCARE GROUP

DESIGNER KARINA TASARIM, DANIŞMANLIK VE EĞİTİM HİZMETLERİ LTD.ŞTİ.

40 Vahit Pafteliler Ave
Tbilisi - GEORGIA
Tel: +995 322 35 05 05

Cell: 0542 849 200 200 / 37/4
A. ÖZGÜLER - 06460 ANKARA / TURKEY
Tel: +90-312-472 62 88 Fax: +90-312-472 62 89 e-posta: info@karina.gen.tr

TECH. CONSULTANCY : KARINA

SYSTEM DESIGN : KARINA

MATERIAL SUPPLY : -

INSTALLATION : -

APPROVAL : -

DATE : 06.03.2021

SCALE : 1/100

DRAWING NO :
EVEX-DEKA-KAR-301-AR-001-002

REV. 00

FILE NAME : C:\EVEX-DEKA-KAR-301-302-303-304-305-AR-