

**Architectural Project**


**Typical Kindergarten**

Plumbing, Electrical Engineering, Heating,  
and Fire Alarm Systems of the Project





Plan of Water Supply System

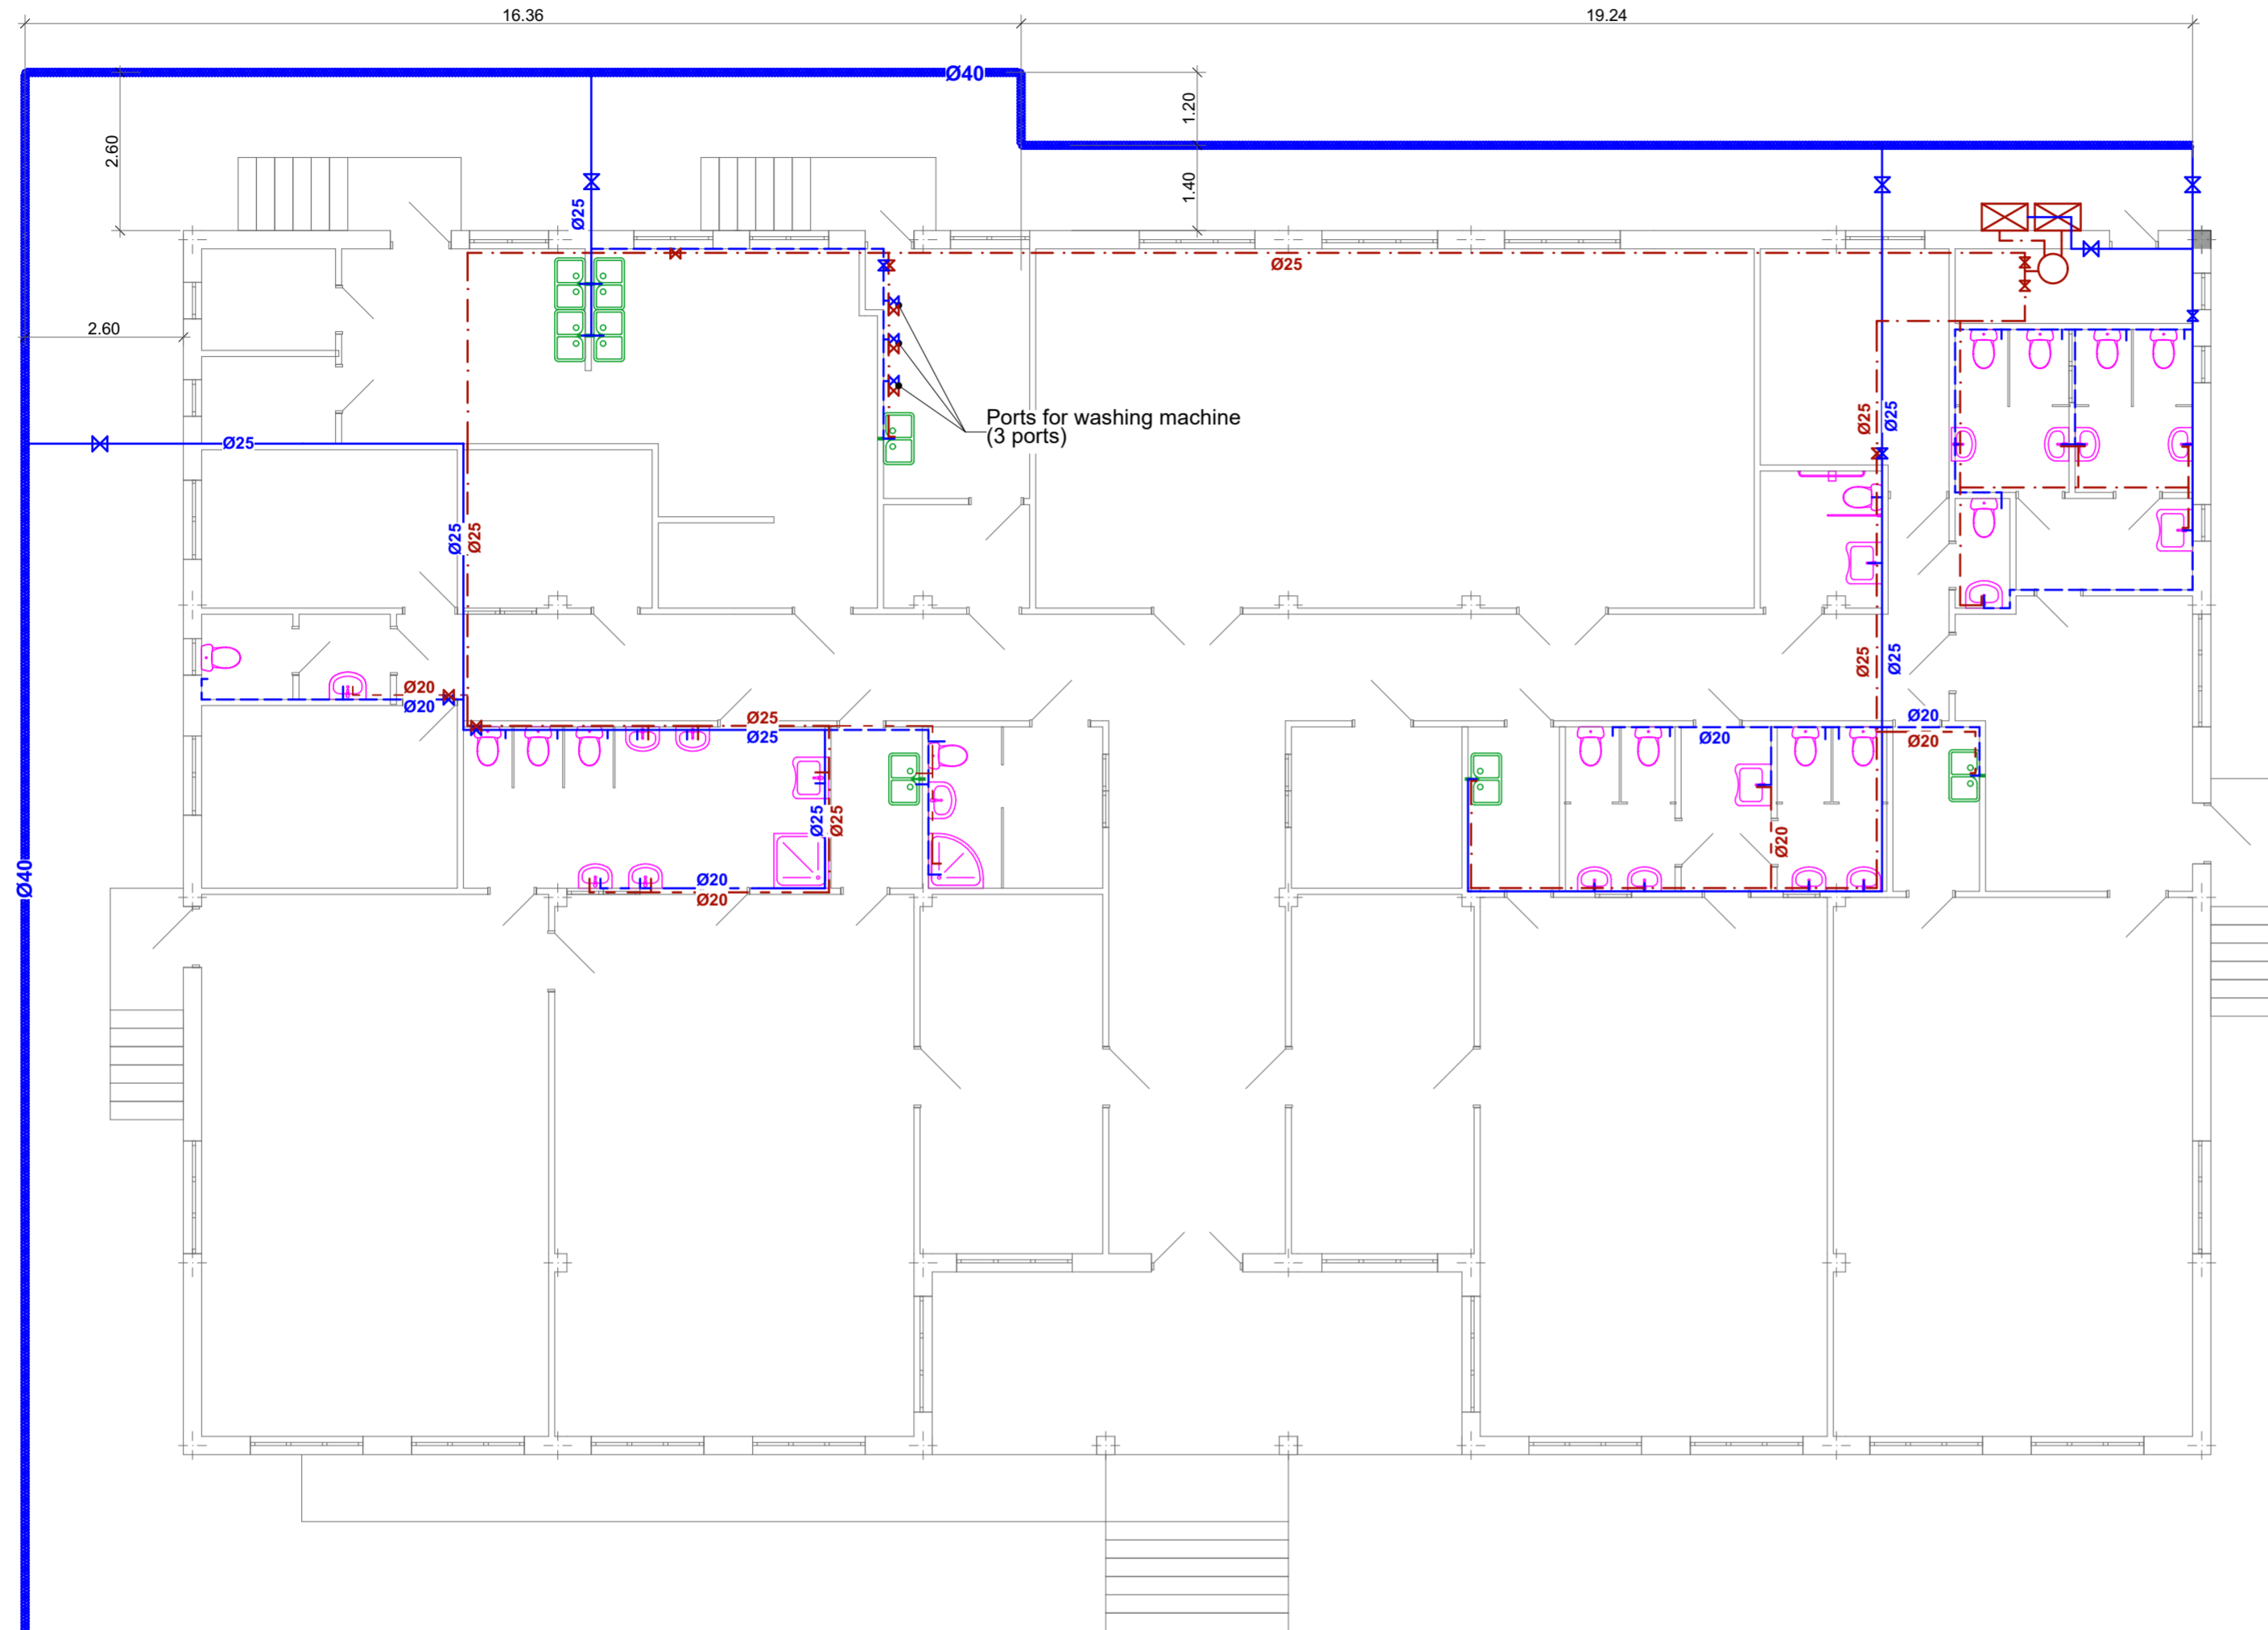

- Cold water pipe of 40 mm D
- Cold water pipe of 25 mm D
- - - - - Cold water pipe of 20 mm D
- - - - - Hot water pipe of 25 mm D
- - - - - Hot water pipe of 20 mm D
- ⊠ Double contour heating boiler
- ⊗ Valve
- Hot water receiver

Note:  
A separate valve (20 mm) will be installed on all toilet bowls.

Water Supply System

The water supply of the building is provided by the urban water supply system. Water is supplied by the inlet under the first-floor slab.  
The water consumption of the three groups of the garden, the kitchen and the staff at different points in the garden is 3.4 m<sup>3</sup>/h. The water supply pipes of the building is made of polypropylene pipes and fittings. Cold and hot water pipes should be provided with heat insulation. First, the 2-meter pipe should be coated with thermal insulation, then it should be covered with the mineral wool of 5 cm thickness (compactd) The service hot water supply of the building is provided by twocircuit heating boilers, creating a stable supply in the receiver.

Sewage System

The internal sewer network of the building is represented by the main manifold of the yard and local area networks of six dwelling units. The yard manifold is connected to the urban sewer manifold provided on the street, and the bottom level of will have to be further specified at the construction phase.  
The local sewage pipes of the dwelling units are provided under the concrete slab of the floor, the horizontal part of the pipe should be packed with heat insulation (10 cm thick). The sewage network is made of 150, 100 and 50 mm polypropylene pipes and fittings. For ventilation of the network 50 mm pillars are located at 0.2 m from the ceiling and are ended in the ventilated attic. The horizontal sections of the sewage network are arranged with the following minimum slope: for 150 and 100 D pipes - 0,015; for 50 D pipes - 0.03.  
Monolithic reinforced concrete sewage manholes can be replaced by assembled structures.


Typical Kindergarten

Stage:  
Architectural project

Plan of Water Supply System


ბ. ჯანთარია  
B. Qantaria

ა. გერგედავა  
A. Gergedava

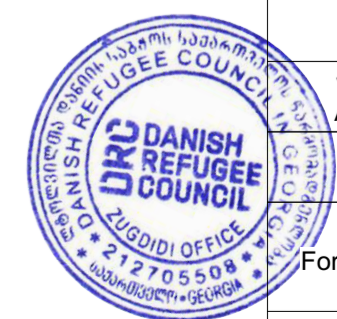

Format A - 2

### Sewage System Plan

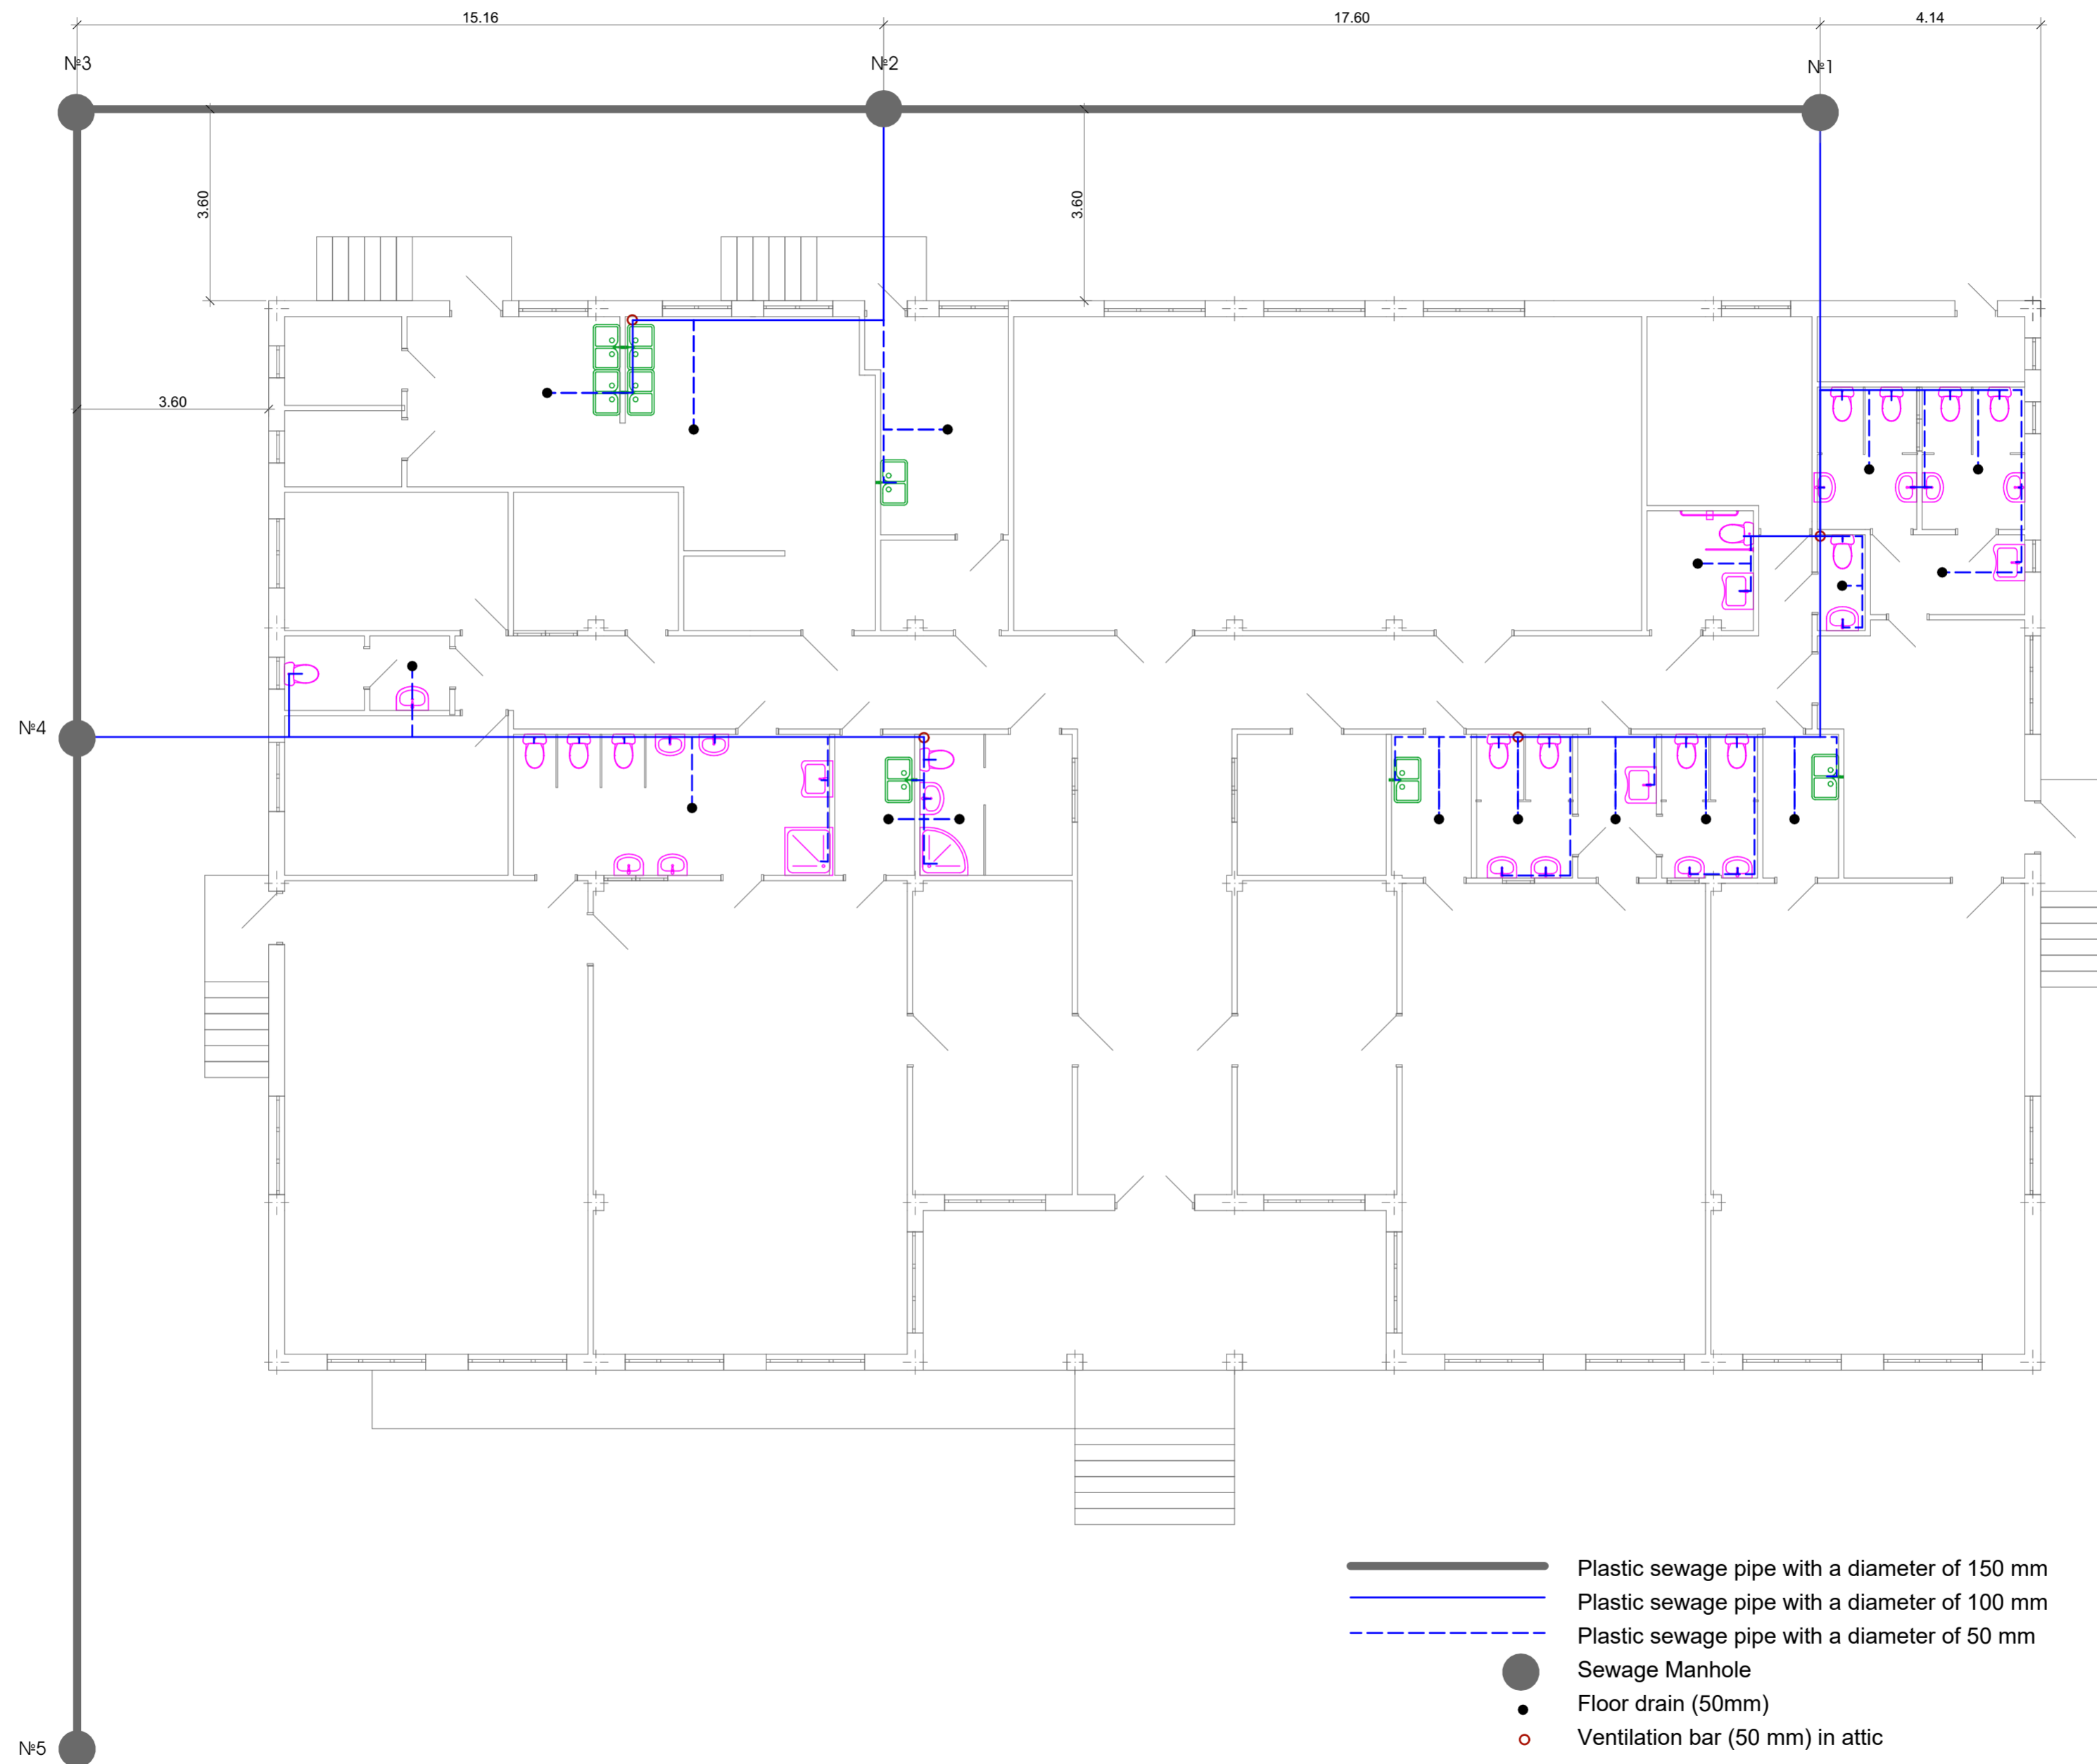

- Plastic sewage pipe with a diameter of 150 mm
- Plastic sewage pipe with a diameter of 100 mm
- Plastic sewage pipe with a diameter of 50 mm
- Sewage Manhole
- Floor drain (50mm)
- Ventilation bar (50 mm) in attic

Typical  
Kindergarten


Project address:  
Georgia,

Stage:  
Architectural project




Sewage  
System Plan

ბ. ჯანთარია  
B. Qantaria


ა. გერგედავა  
A. Gergedava

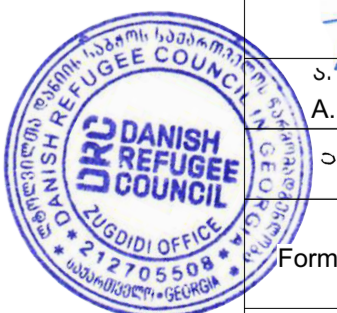

Format A - 2

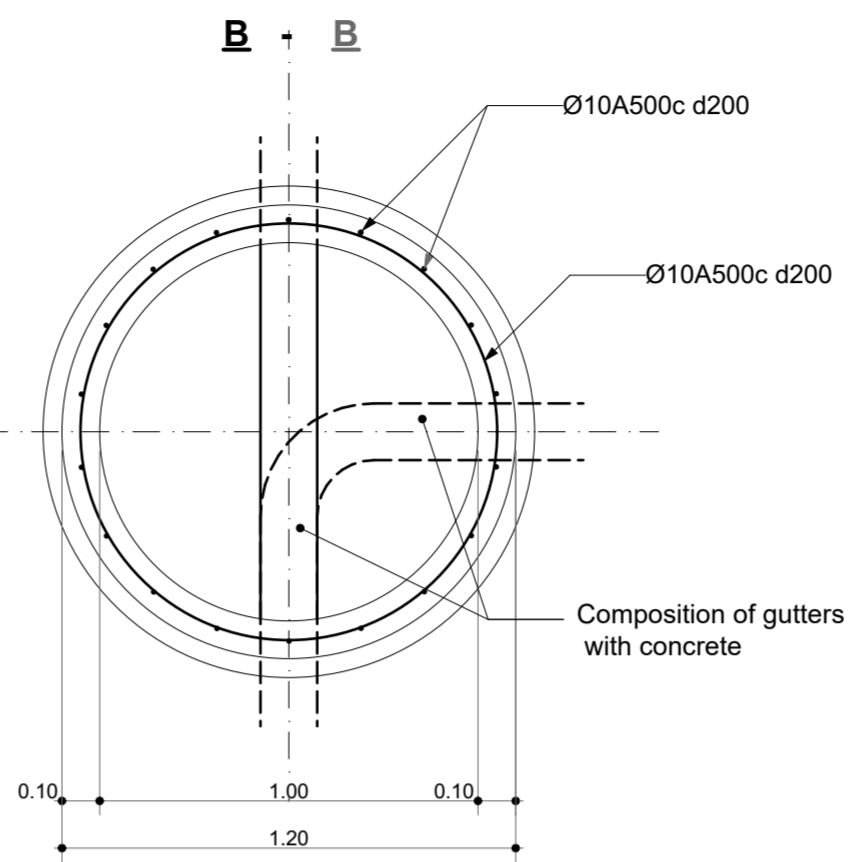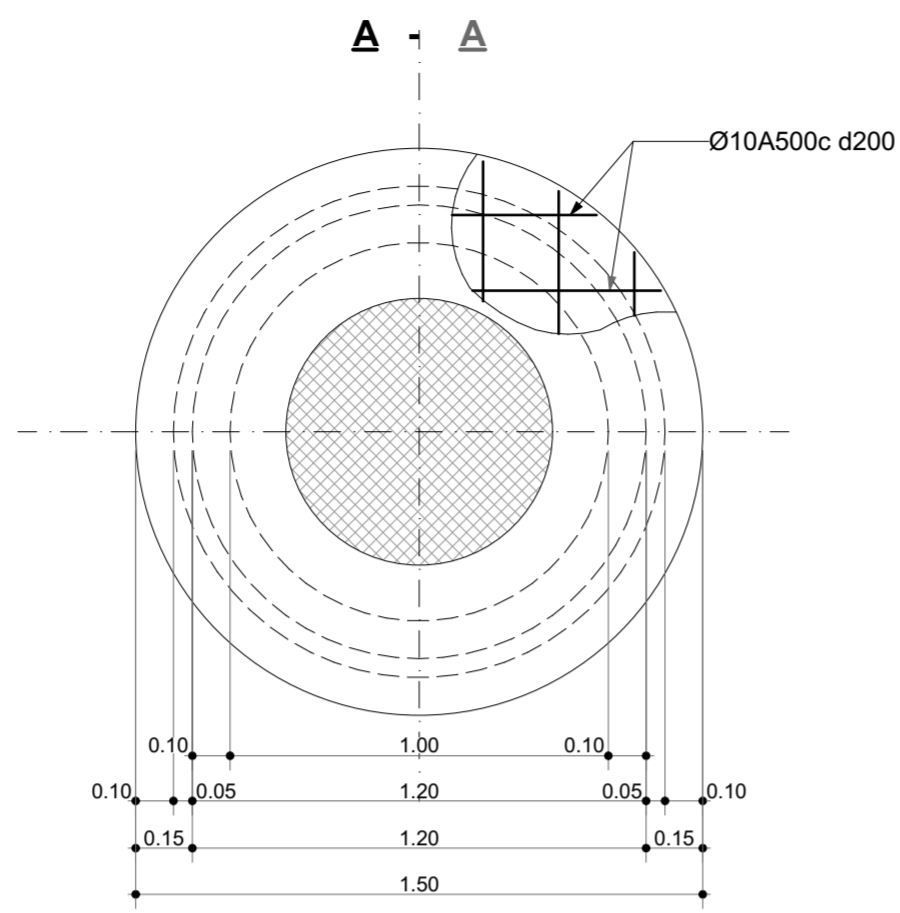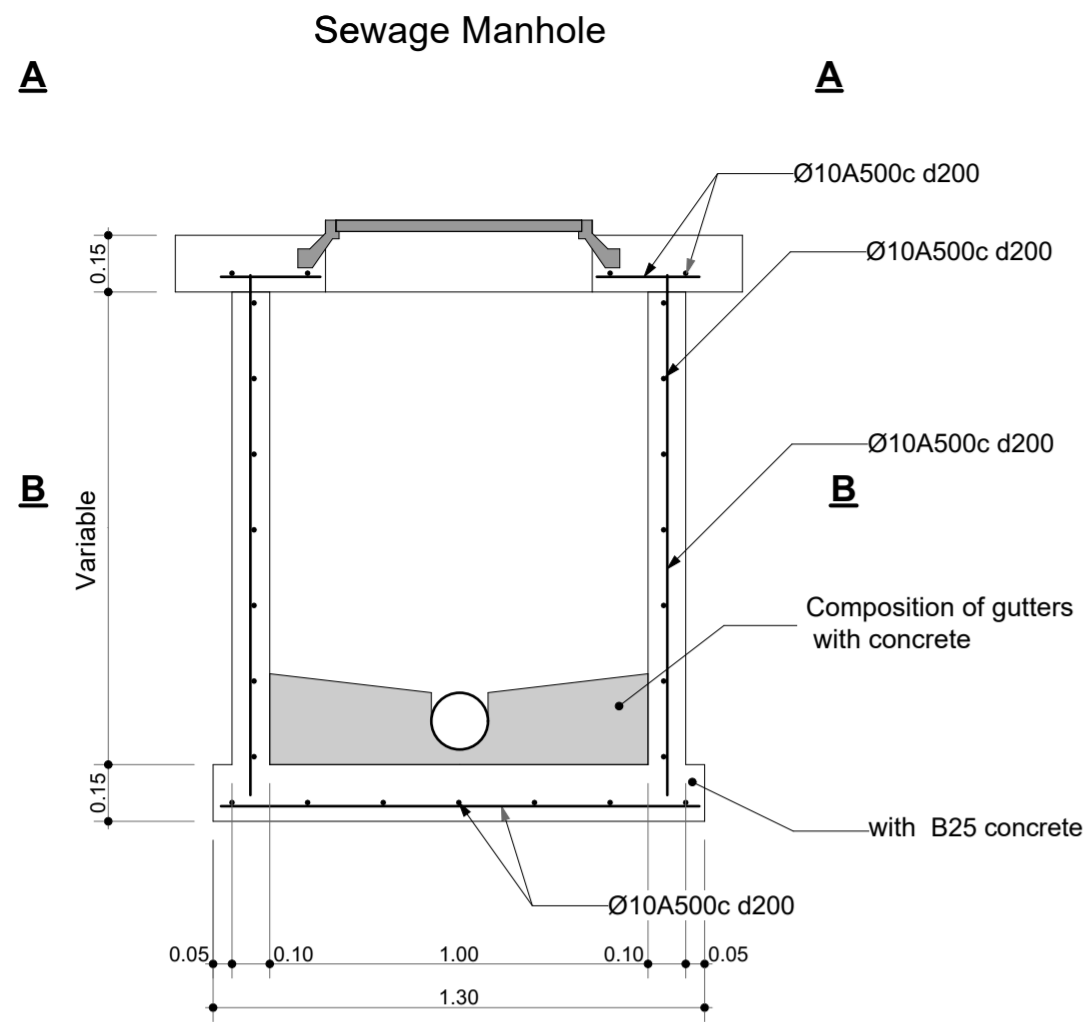

Location of pipes in floor cross section

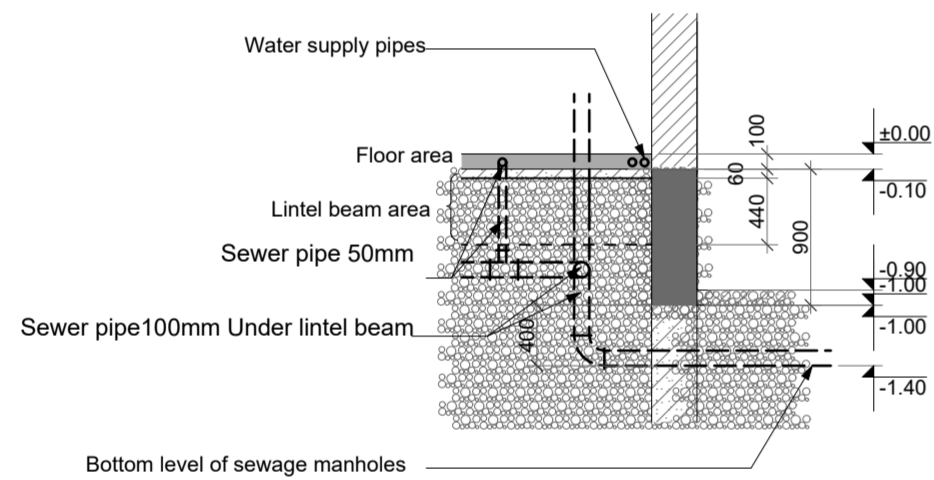

**Specifacaton**

Water Supply	List	UoM	Q-ty
Wash stand		Set	7
Children's wash stand		Set	12
Wash stand with accessories for disabled		Set	1
Kitchen double-sink		Set	8
Wash stand mixer		Set	19
Mixer of Wash stand for disabled		Set	1
Mixer of Kitchen double-sink		Set	8
Children's Toilet bowl		Set	11
Toilet bowl		Set	3
Toilet bowl with accessories for disabled		Set	1
Shower tray 90x90		Set	2
Shower mixer		Set	2
Plastic hot water pipe with fiberglass 25 mm		Meter	105
Plastic hot water pipe with fiberglass 20 mm		Meter	40
Plastic cold water pipe 25 mm		Meter	134
Plastic cold water pipe 20mm		Meter	84
Plastic cold water pipe 40mm		Meter	120
Valve 40		pcs	1
Valve 25		pcs	8
Valve 20		pcs	30
Fittings, 60% of pipe cost			
<b>Sewage</b>			
50mm thick plastic sewer pipe		Meter	104
100mm thick plastic sewer pipe		Meter	95
150mm thick plastic sewer pipe		Meter	110
Stainless steel floor drainage 50 mm		pcs	17
Sewage manhole		set	5
Fittings, 60% of pipe cost			

Typical Kindergarten

Project address:  
Georgia,

Stage:  
Architectural project

Longitudinal Profile of Sewage Collector


ბ. ჯანთარია  
B. Qantaria

ა. გერგდავა  
A. Gergedava


Format A - 2

Page 4  
Pages 13

**Longitudinal Profile of Sewage Collector**

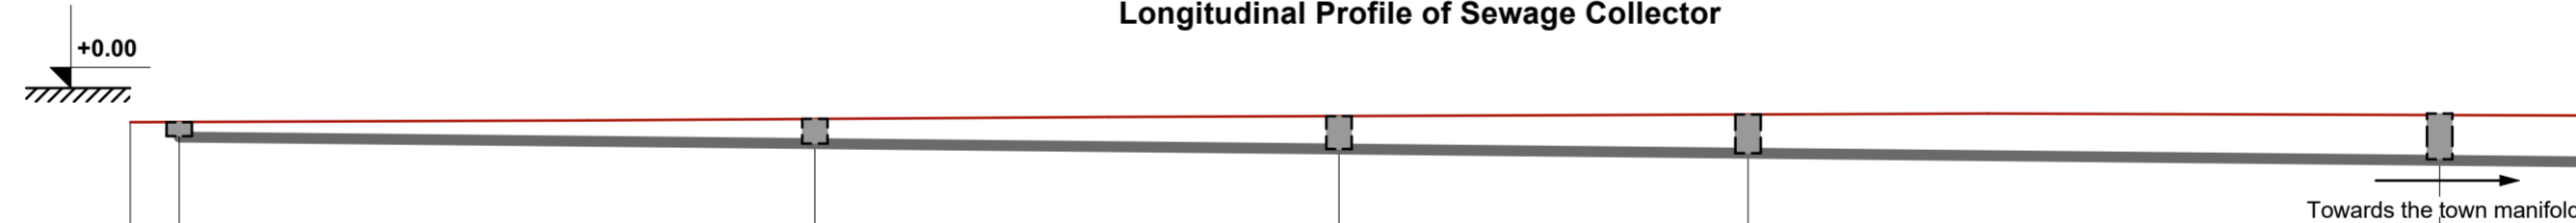


Bottom mark of pipe	-21.60 (-1.70)	-21.40 (-1.90)	-21.25 (-2.05)	-21.10 (-2.20)	-20.90 (-2.40)
Centre-line ground elevation	-21.95	-21.75	-21.80	-21.90	-22.05
Design elevation of the manhole cover	22.20	22.15	22.10	22.20	22.25
Manhole depth in cm	60	75	85	110	130
Diameter of pipe in mm	150	150	150	150	150
slope		i=0.01	40.5	i=0.01	
distance	18.4	15.1	11.8	20.0	
Marking point	manhole #1	manhole #2	Manhole #3	Manhole #4	Manhole #5

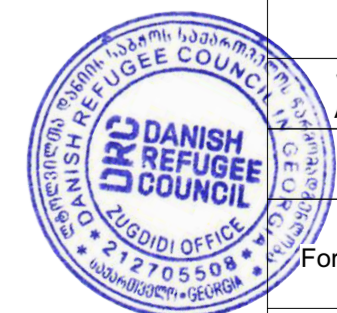



Plan of Heating System of the Floor

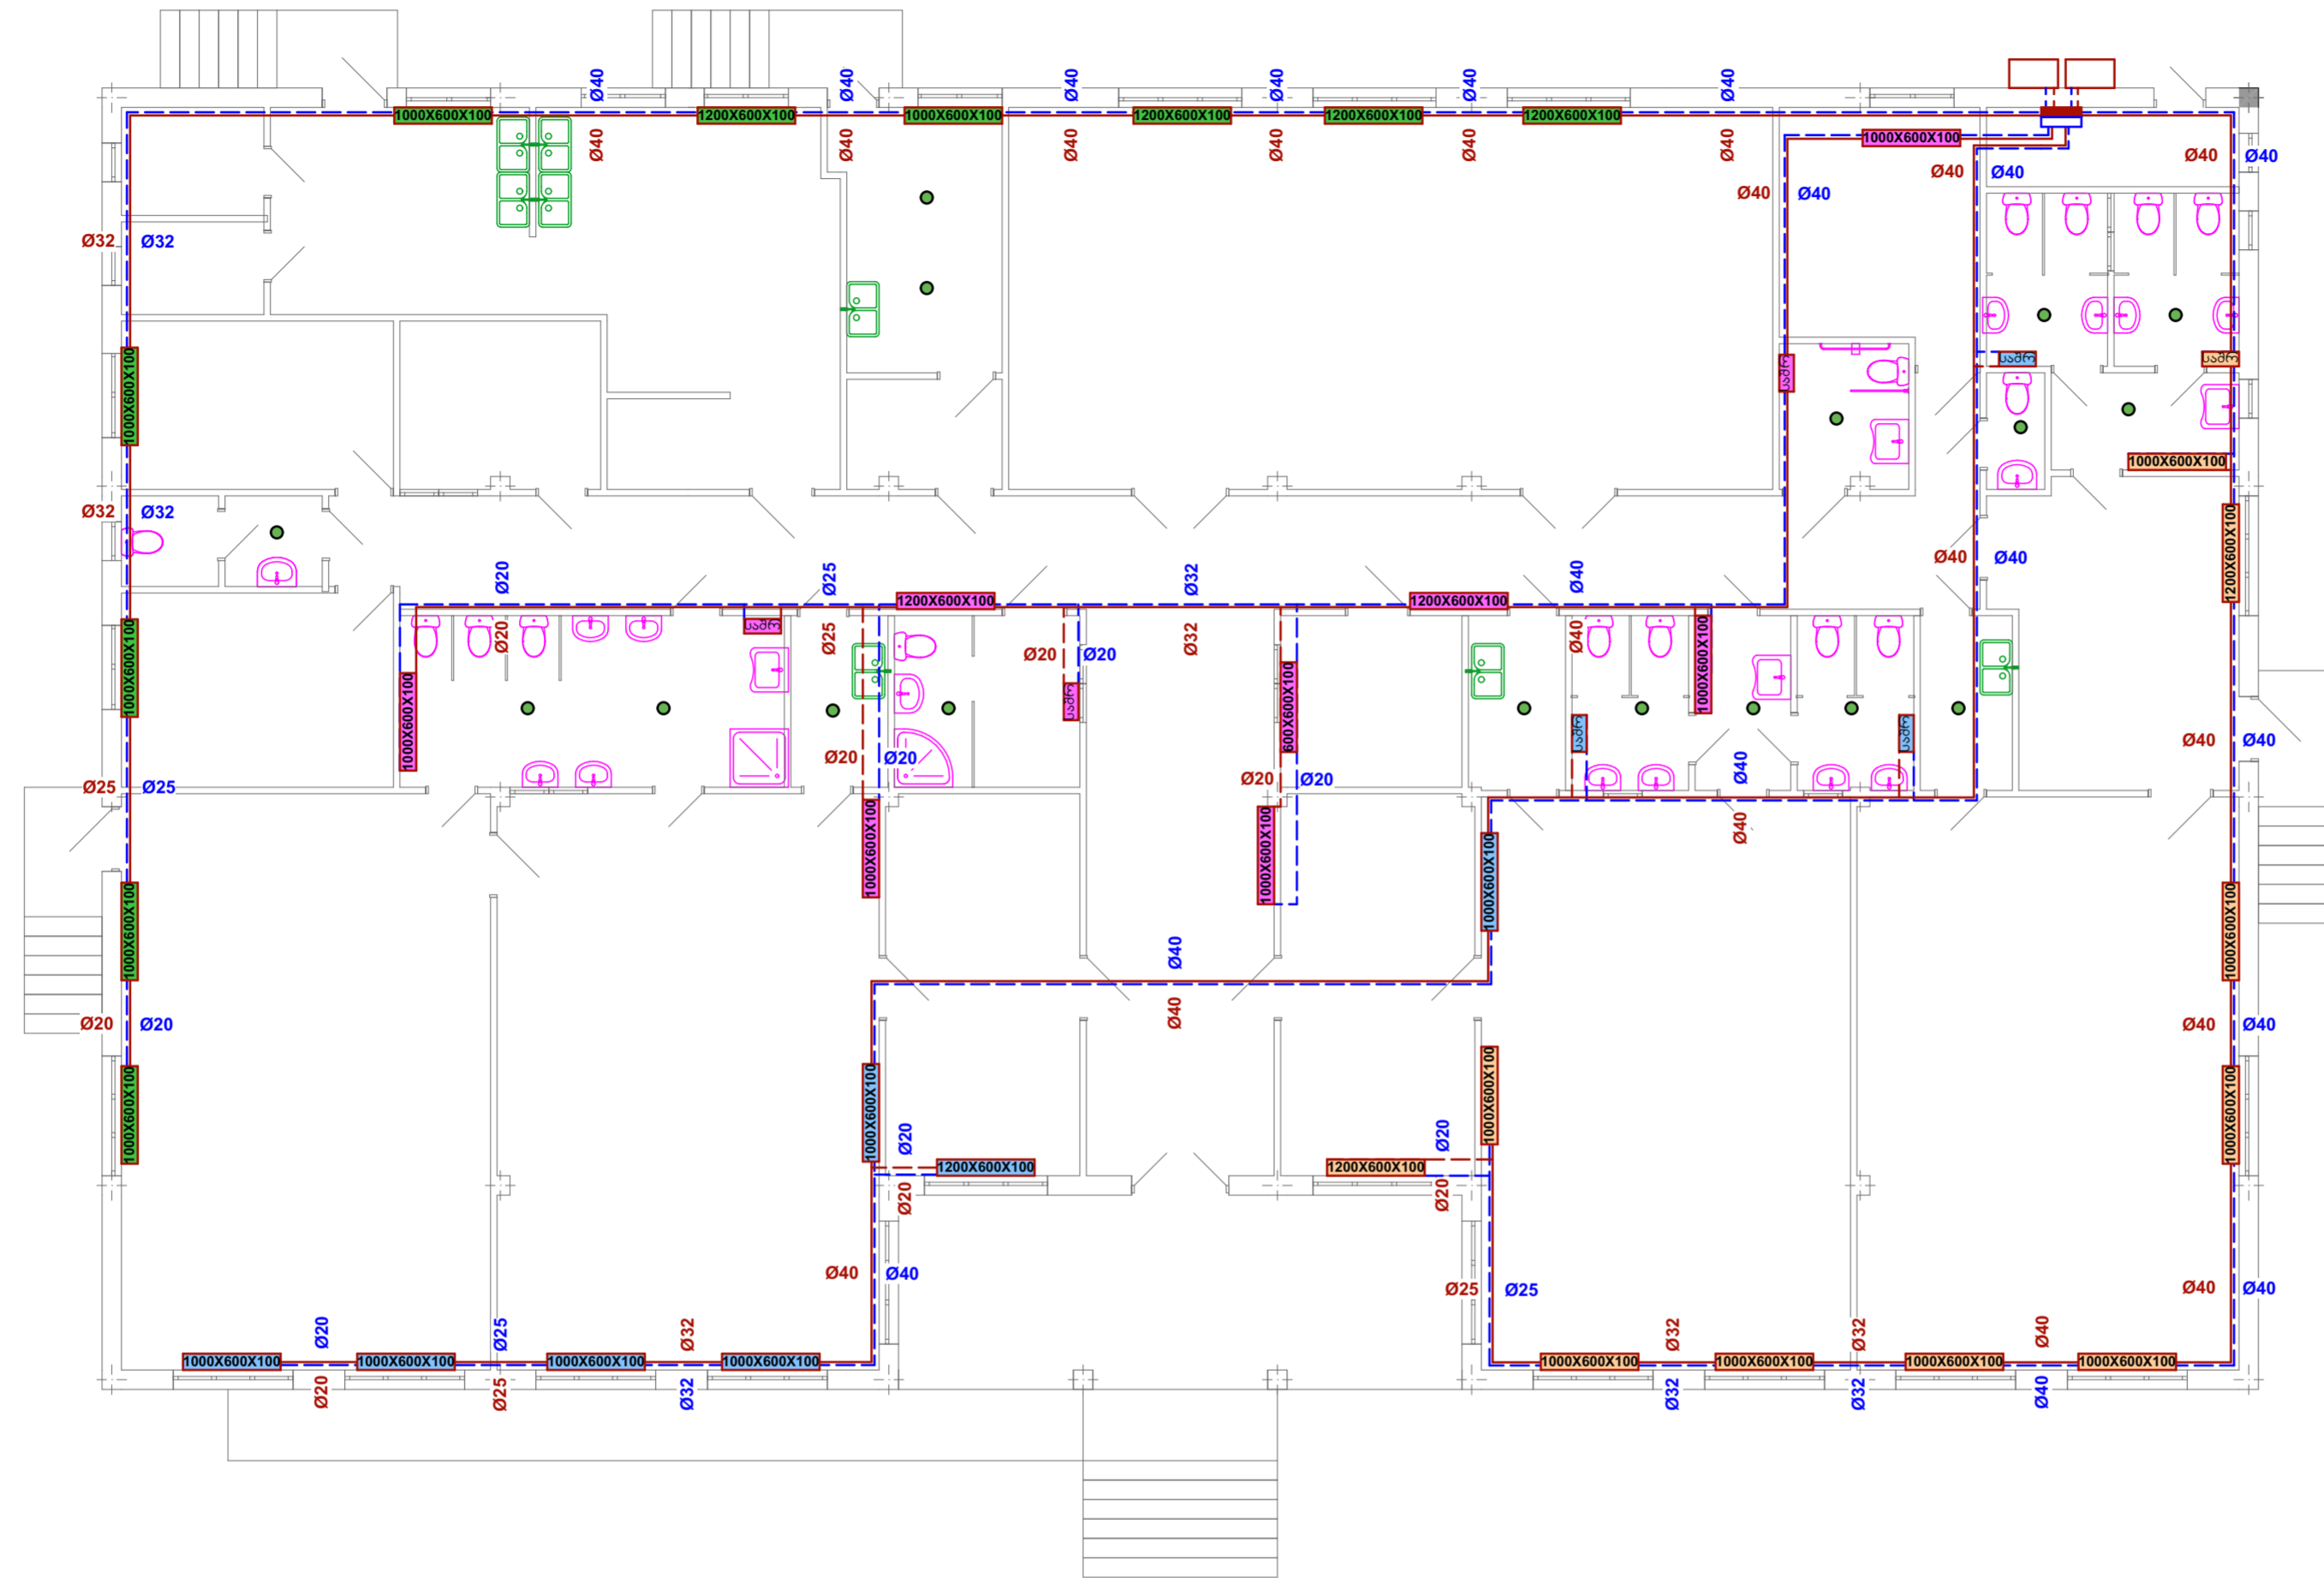

Heating System

Explanatory Letter

Legends:

- 1000X600X100 Steel panel radiator
- 1200X600X100 Steel drier
- Plastic inlet pipe
- Plastic return pipe
- Double contour heating boiler
- Manifolds
- Fan (for 100 mm pipe)

-The designed heating system is double-pipe, horizontal. -The heat conductor is water. With a temperature of 65-50C. - Metal panel radiators are used as heating device, 600 mm height

- Pipes will be installed while floor preparation with insulation.
- External heat reporting temperature accepted - 80.
- Heating boilers, 40 kW -1 and 10 kW 5, are selected for heating. Double-contour with coaxial smoke pipe and automation.
- Hydro models and manifolds are installed with boilers.

Typical Kindergarten

Project address:  
Poti, Georgia

Stage:  
Architectural project


Plan of Heating System of the Floor

ბ. ჯანთარია  
B. Qantaria


ა. გერგედავა  
A. Gergedava

Format A - 2

Page 5  
Pages 13

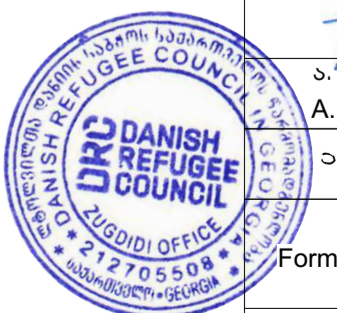

Axonometric Diagram of the Heating System

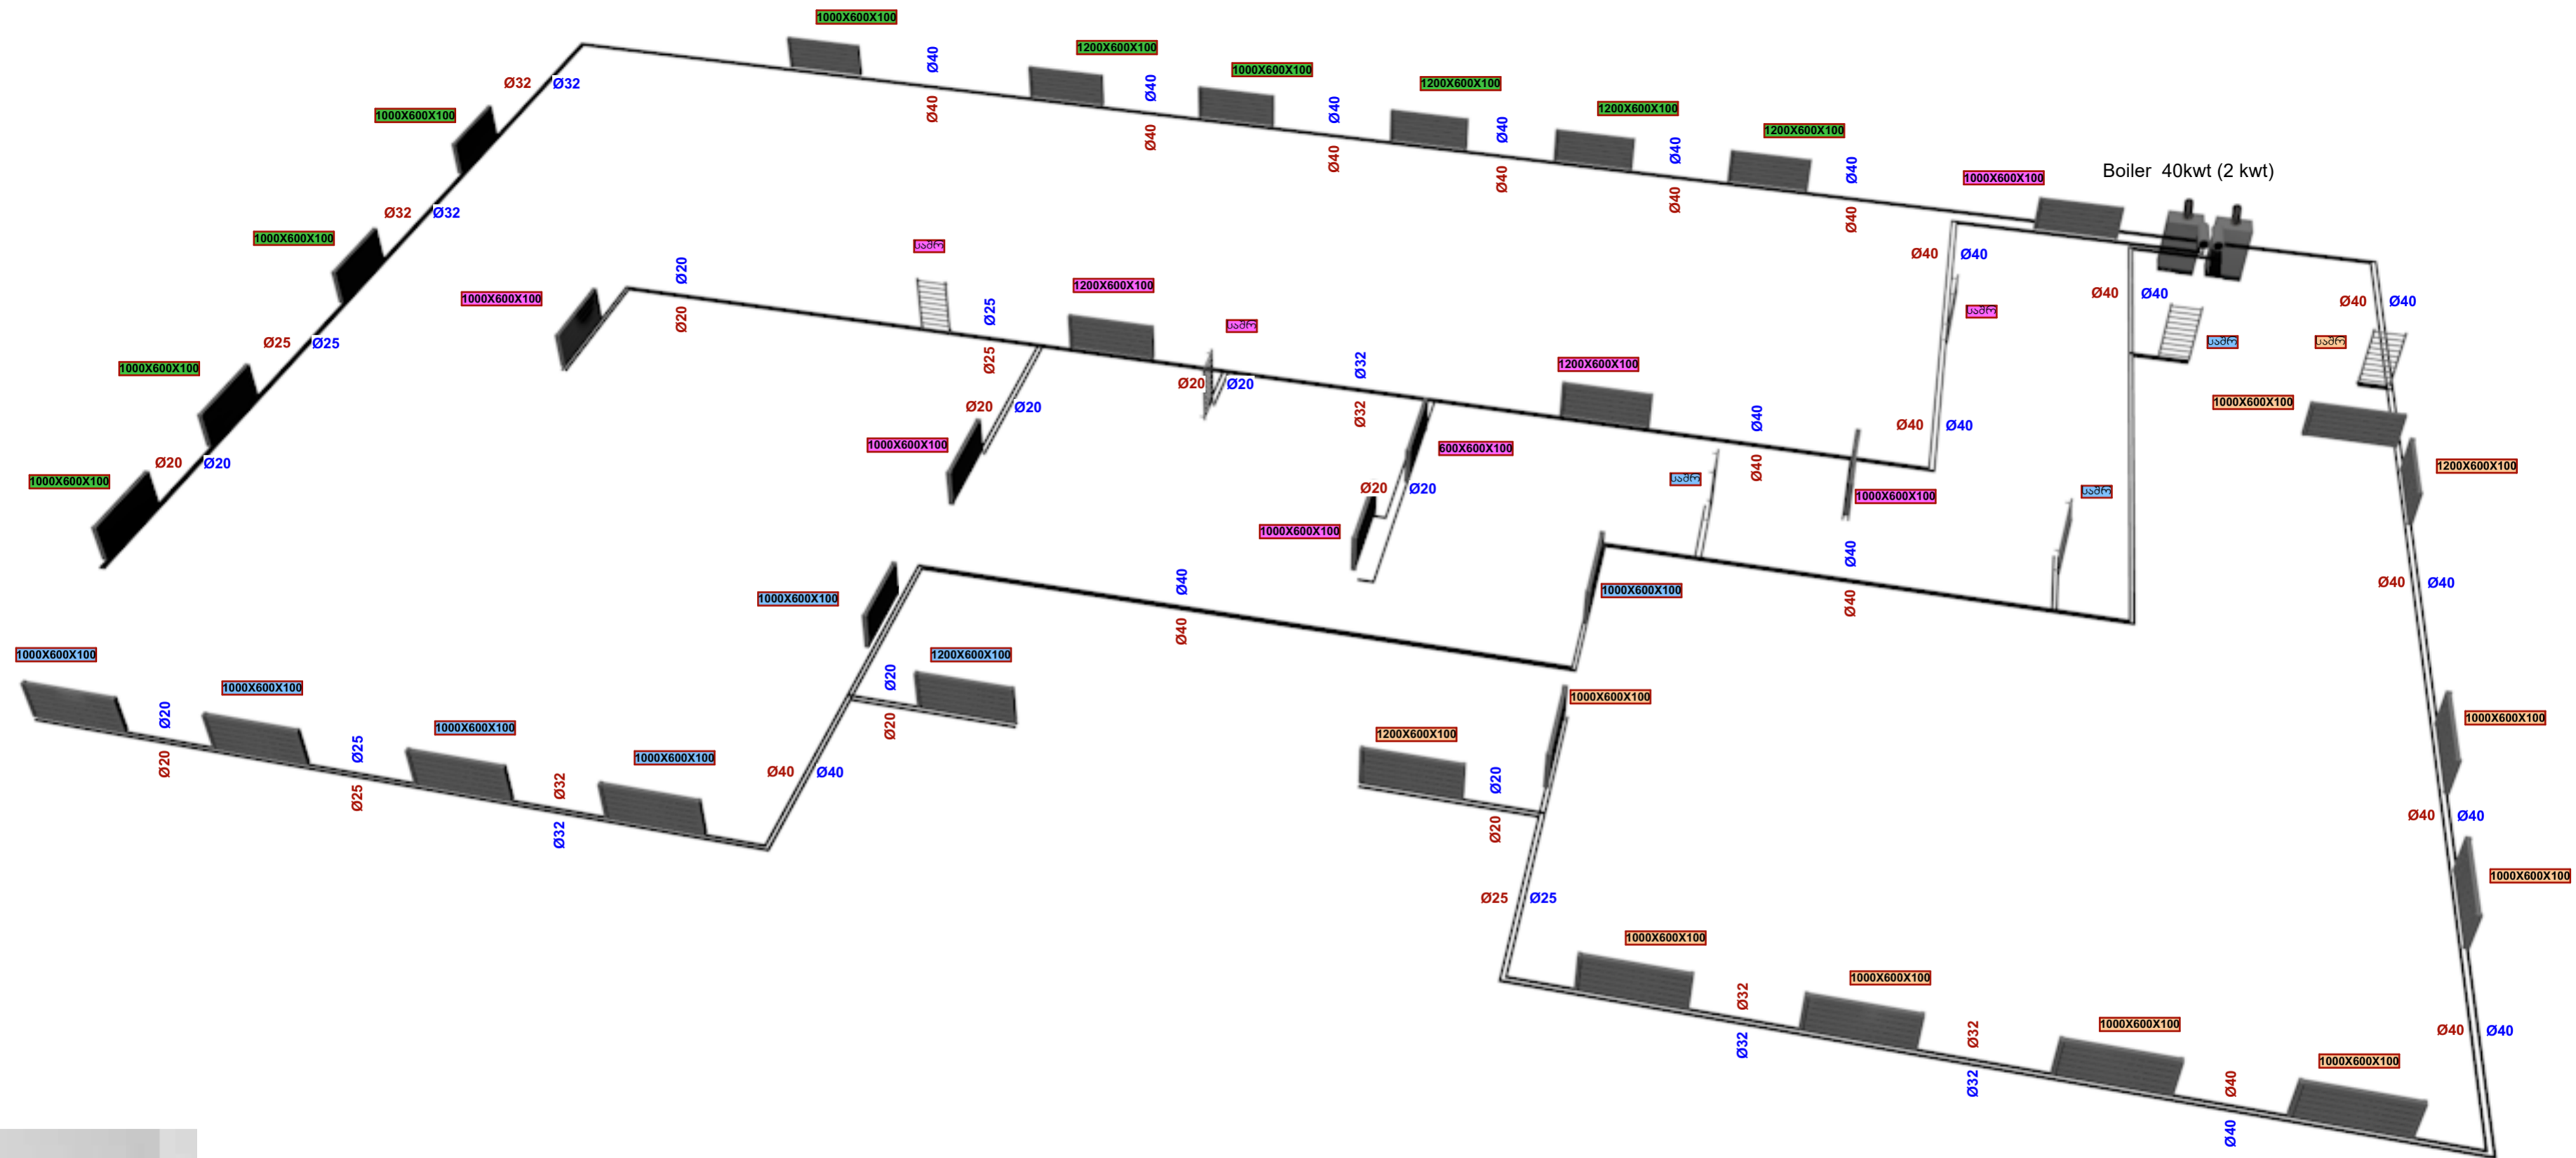

Typical Kindergarten

Project address:  
Poti, Georgia

Stage:  
Architectural project

Axonometric Diagram of the Heating System

ბ. ქანთარია  
B. Qantaria

ა. გერგედავა  
A. Gergedava


ფორმატი  
Format

A - 2


ფურცელი Page	ფურცლები Pages
6	13





Steel Wall Box fo Heating Boiler

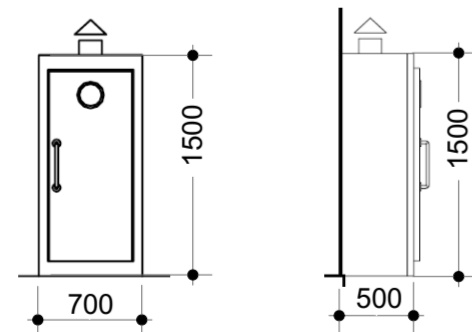

Kitchen ventilation scheme

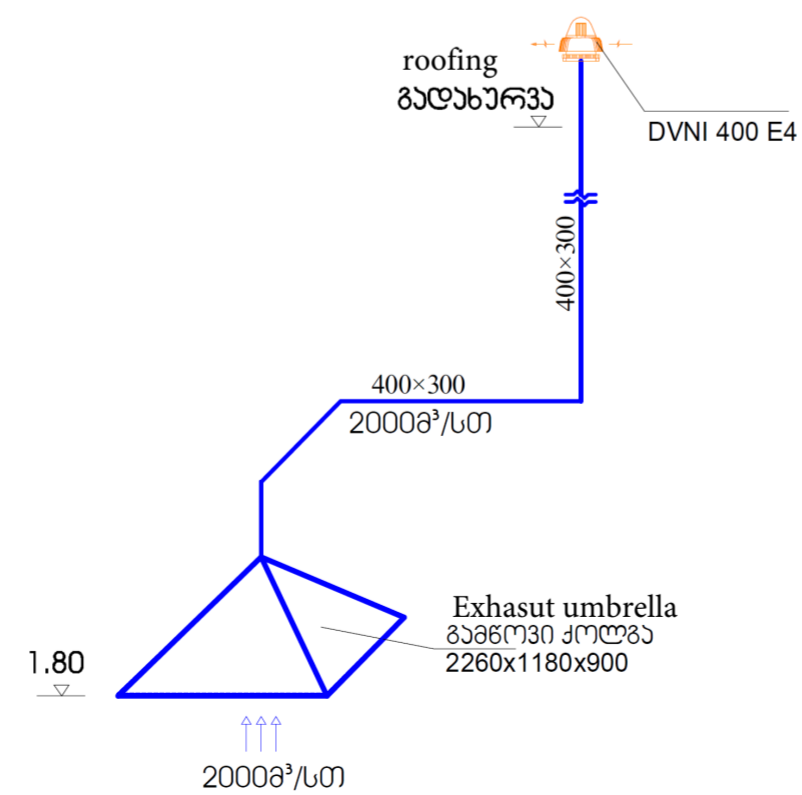


Sanitary Units Ventilation Scheme

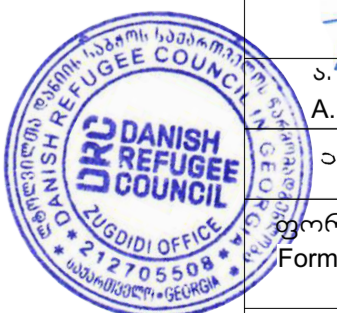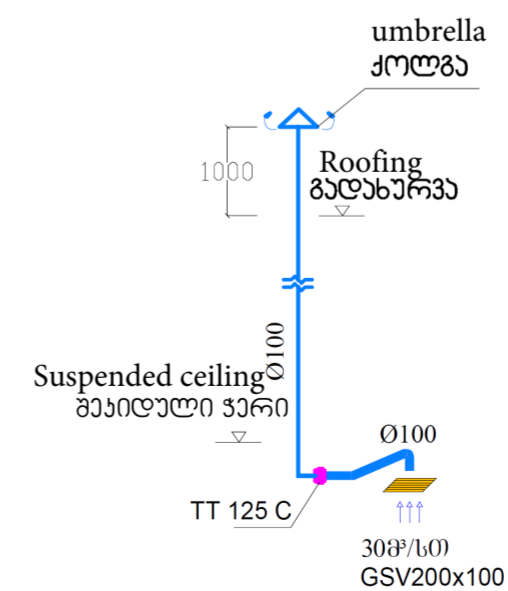





Principal Plan of the Heating System

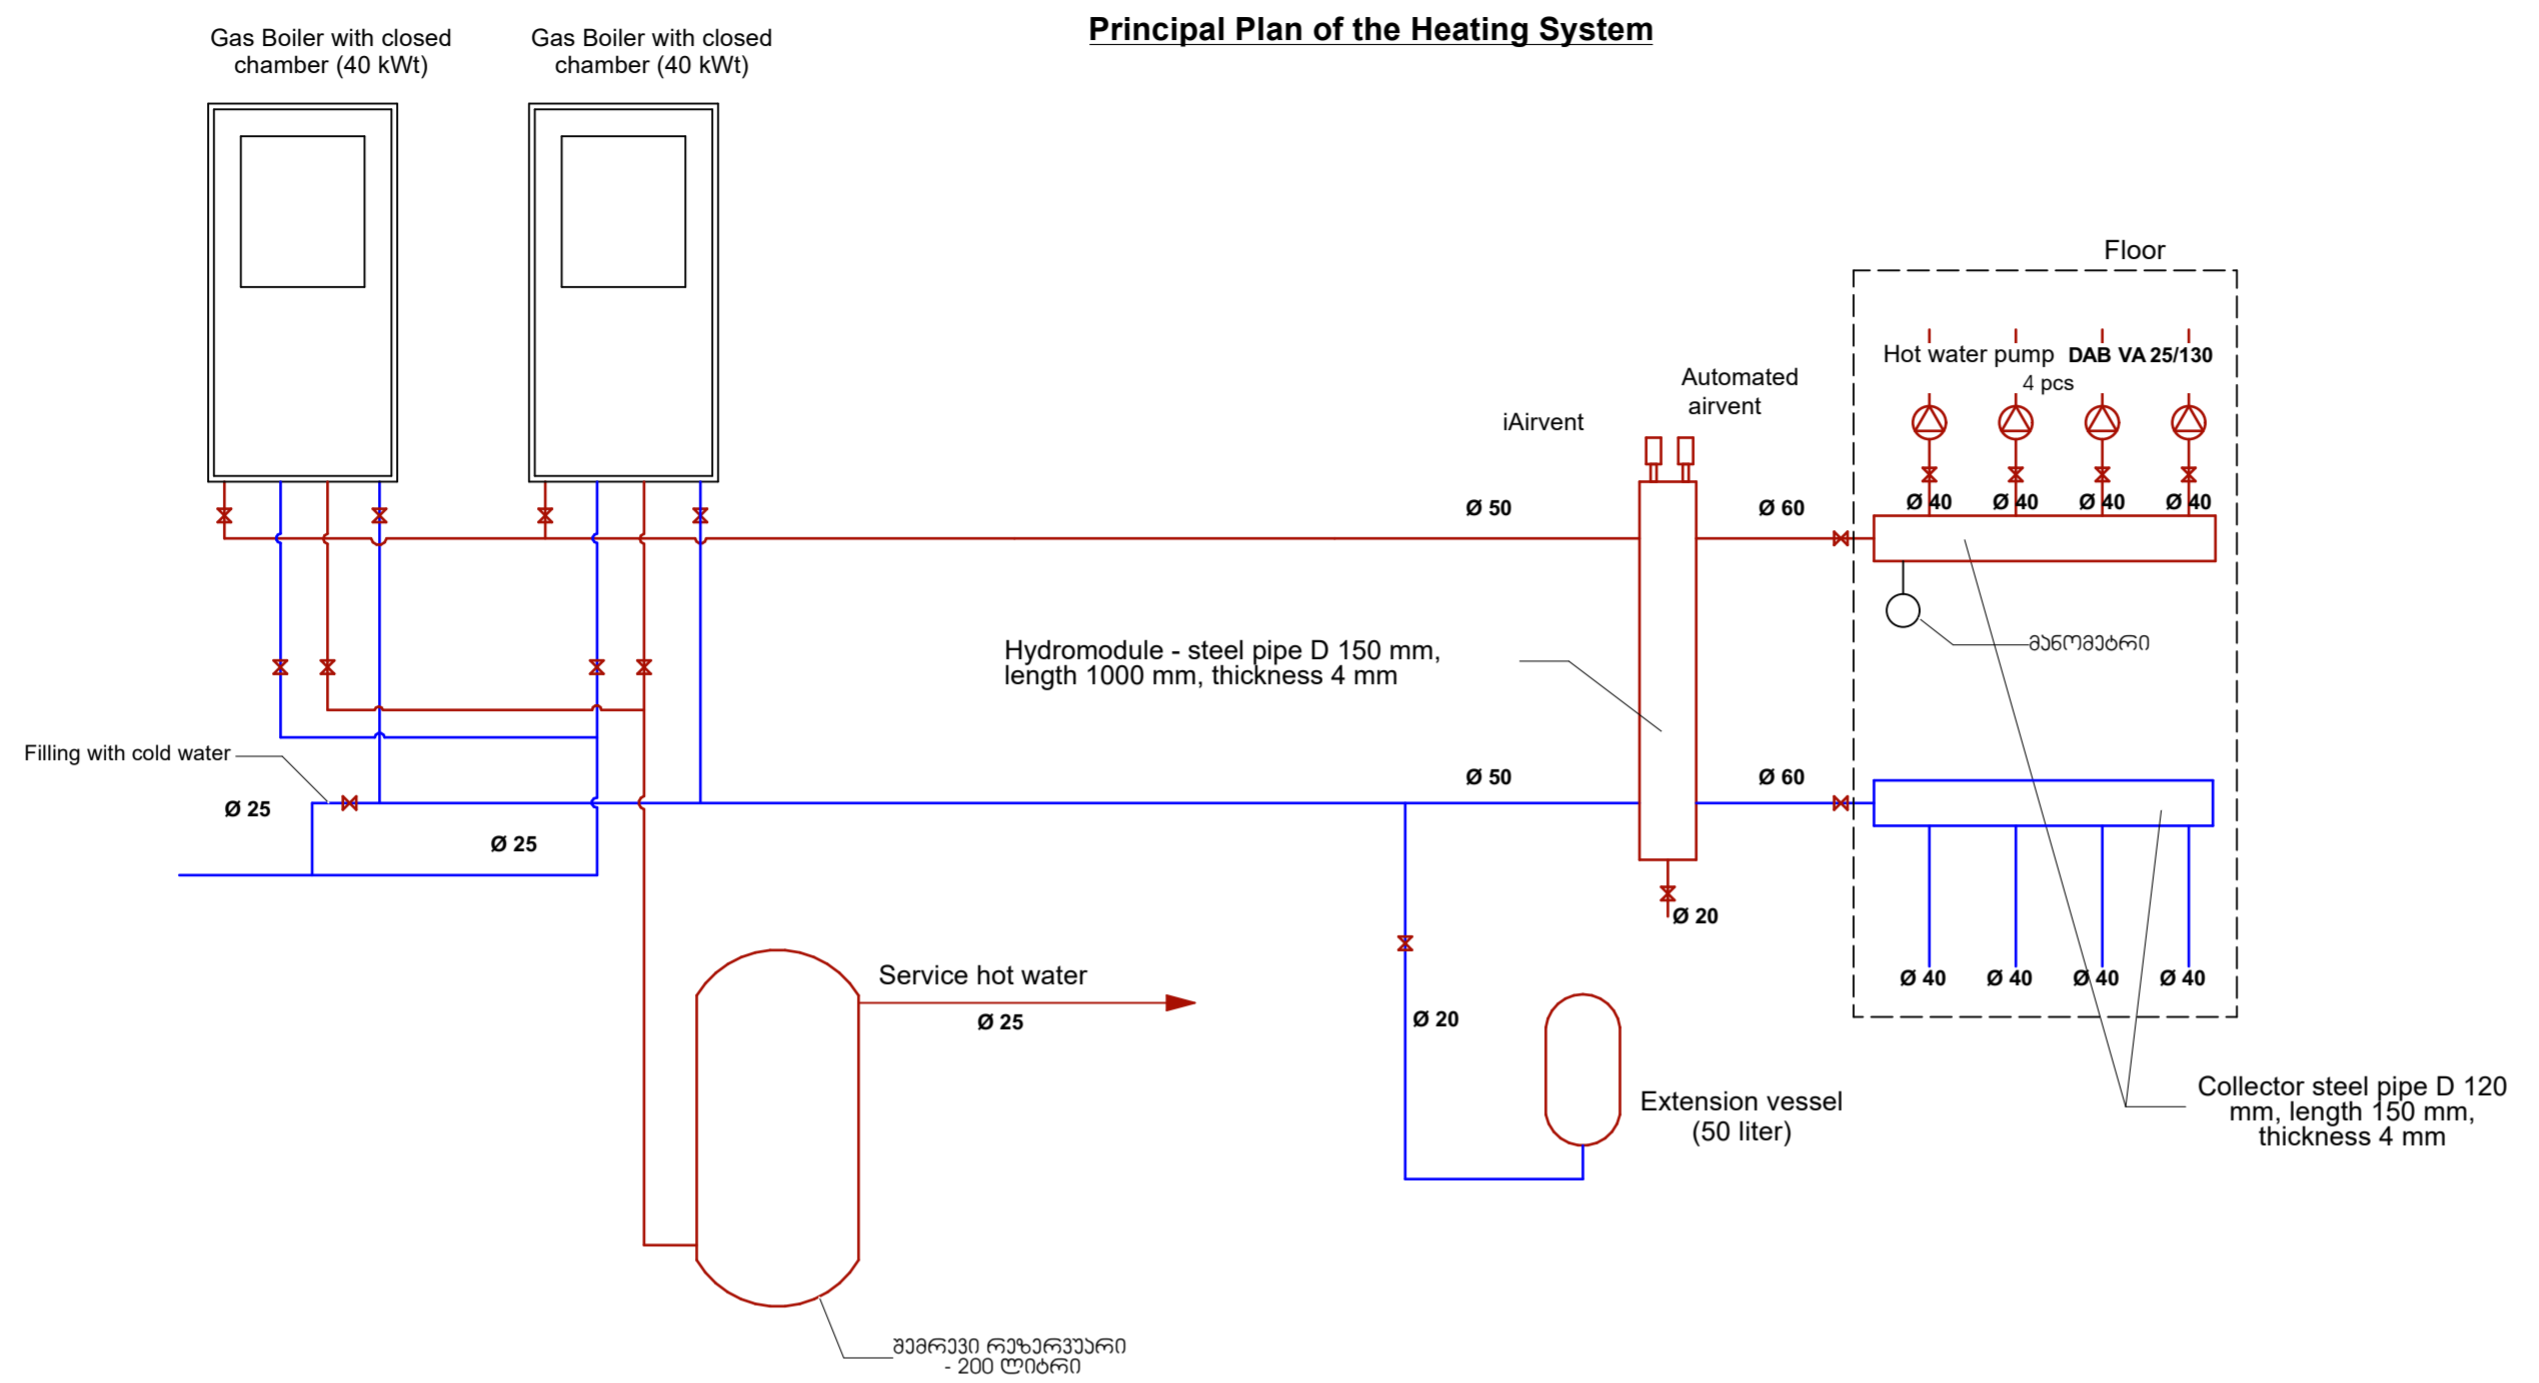

Panel radiator connection diagram

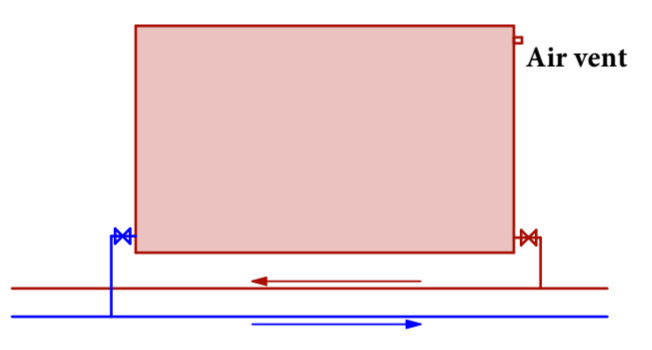


HYDROMODULE ჰიდრომოდული

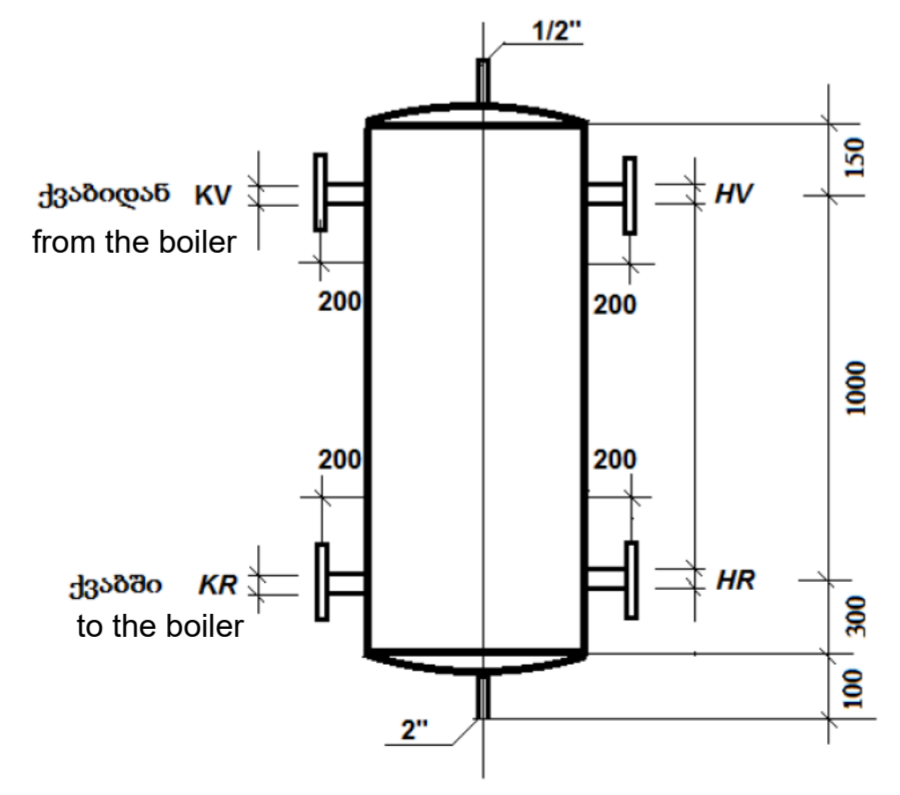

kg/h	D მმ	KV მმ	KR მმ	HV მმ	HR მმ
8000	150	50	50	65	65


Specification

List	UoM	Q-ty
Gas boiler (40 kW) double circuit with coaxial pipe	Set	2
Extension vessel (50 liter)	Set	1
Locking valve 40mm	Pcs	8
Safety valve 3.0 atm	Pcs	2
Metal pipe 150mm for collectors	meter	2
Hydromodule	Pcs	1
Heating circulation pump DAB VA 25/130	Pcs	4
Automated air vent	Pcs	2
Plastic pipe insulated with fiberglass 40mm	meter	205
Plastic pipe insulated with fiberglass 32mm	meter	138
Plastic pipe insulated with fiberglass 25mm	meter	115
Plastic pipe insulated with fiberglass 20mm	meter	
fittings 60% of pipe cost		
Steel panel radiators 600X600X100	Pcs	1
Steel panel radiators 1000X600X100	Pcs	2
Steel panel radiators 1200X600X100	Pcs	7
Bathroom drier 1200 mm	Pcs	7
Radiator valve on supplying (inlet) pipe	Pcs	42
Radiator valve on return pipe	Pcs	42
Mixer reservoir 200 liter	Pcs	1

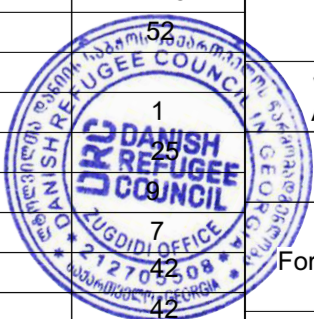


Inlet distribution shield

ain line #	m-1	m-2	m-3
total capacity in kWt	39.0	35.4	39.0
Calculated capacity in kWt	32.5	29.7	32.1
Calculated oltage in A	49.2	45	48.6
engt in m	14	25	11

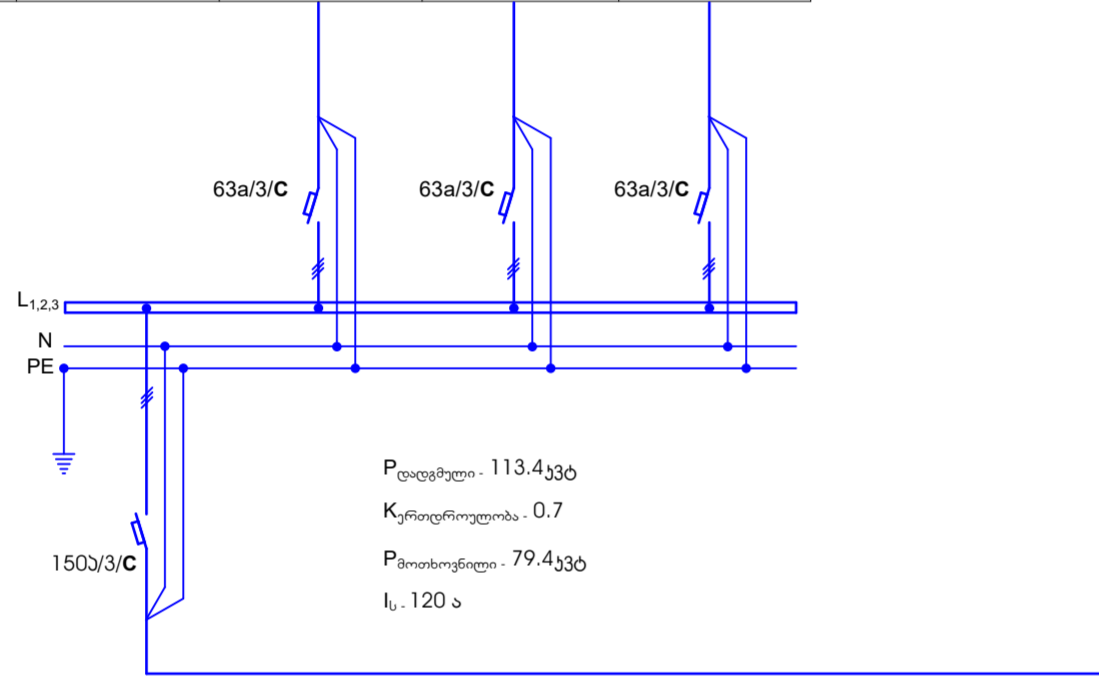

Kitchen High-Power Shield

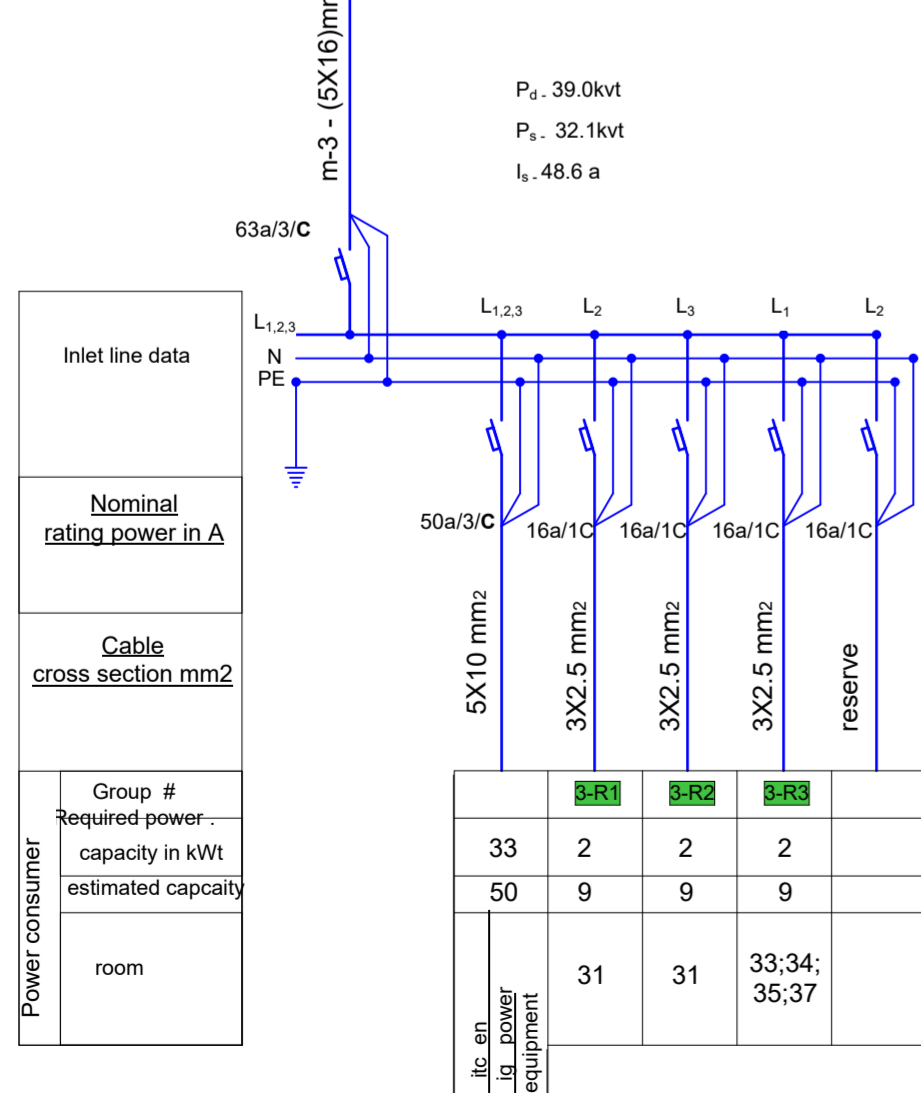

Electric-Engineering Part

Explanatory Letter

The electrical and technical part of the project of this building is based on the architectural, structural, water supply and sewage parts of the same project. -In terms of reliability of energy supply, the object belongs to category III.

- Voltage parameters: voltage 400/230 V - Frequency 50 H - Maximum permissible voltage drop 5% (2.5% on incoming cable, 2.5% on the project site) Grid (L1, L2, L3, N, PE) The electricity of the building is supplied from the existing network. In order to receive and distribute electricity, there is a distribution shield in the corridor of the building, from where the electricity is supplied to the distribution shields and accordingly to all the units of the building, a separate shield is designed for the supply of kitchen power network.

-Electricity metering is done by a three-phase active power meter, the location of which is determined in agreement with the local electricity service.

- LED bulbs are used for lighting. The height of the installation of plugs for children is 1.8m above the floor.

The entire electricity network is made of a non-halogen copper cable, with double insulation that will be installed on the ceiling and under the plaster of the walls. Under the ceiling and on the ceiling, the cables and wires shall each be inserted separately into plastic pipes, where, in case of need, the appropriate channels will be cut in the walls.

-In the absence of a TN-S network, the system must be adjusted to TN-C-S- It is planned to ground the main distribution shield. Grounding resistance should not exceed 4 warps at any time of the year. - Installation works must be carried out in full compliance with the rules of arrangement of electrical installations.

- The calculation of the illumination network envisages the possibility of replacing the incandescent bulbs in the network.

Specification

#	List	UoM	Q-ty
1	Inlet-Distribution box,IP rating 43 automatic opening circuit breaker: inlet 150A/3-1 pcs outlet groups - 63 A/3- pcs	set	1
2	Electric distribution box (for lighting) IP rating 30, automatic circuit breaker: inlet 63 A/1- pcs outlet groups - 16A/1-12 pcs, 10A/1-12 pcs	set	2
3	Kitchen high-power shield, IP rating 30 automatic opening circuit breaker : inlet 63A/3-1 pcs, outlet groups 50A/3-1 pcs? 16 A/3-4 pcs	set	1
4	Two-pole outlet socket with the third grounding circuit 10Amp	pcs	38
5	One-pole outlet socket with the third grounding circuit 10Amp	pcs	26
6	One-pole outlet socket air-tight with the third grounding circuit 10Amp	pcs	16
7	One-pole outlet socket for AC , with the third grounding circuit 16Amp	pcs	9
8	Distribution box	pcs	84
9	One-key switch	pcs	10
10	One-key switch, air-tight	pcs	10
11	Two-key switch	pcs	12
12	Two-key switch, air-tight	pcs	17
13	Lighting fixture for room LED 18 W	pcs	94
14	Spot Lighting fixture for room LED 18 W	pcs	34
15	Spot Lighting fixture for room LED 18 W	pcs	29
16	Copper cable with double insulation , cross section 3X1.5 m2	meter	1410
17	Copper cable with double insulation , cross section 3X2.5 m2	meter	1510
18	Inlet copper cable with double insulation, cross section 5X35 m2	meter	60
19	Inlet copper cable with double insulation, cross section 5X16 m2	meter	49

Typical Kindergarten

Project address:  
Georgia,

Stage:  
Architectural project

Principal Plans  
of Shields



ბ. ჯანთარია  
B. Qantaria

ა. გერგედავა  
A. Gergedava

Format A - 2


Page 8  
Pages 13

Grounding contour


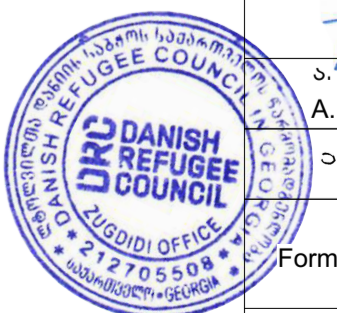
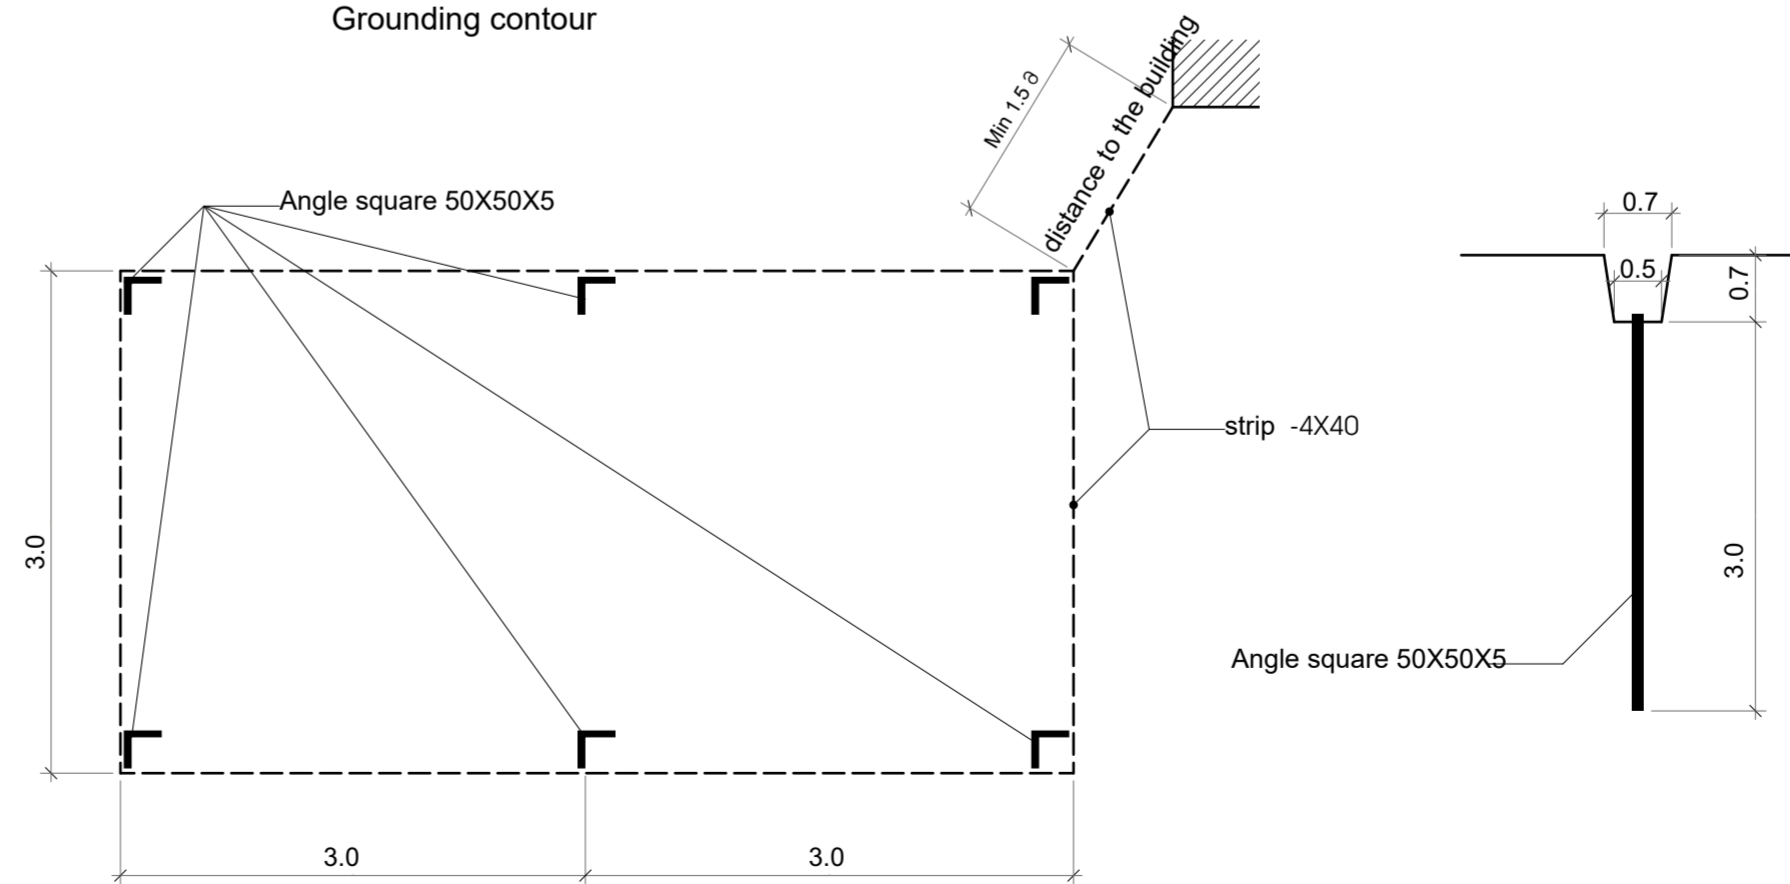




**Principial Plan of the Distribution Shield #1**

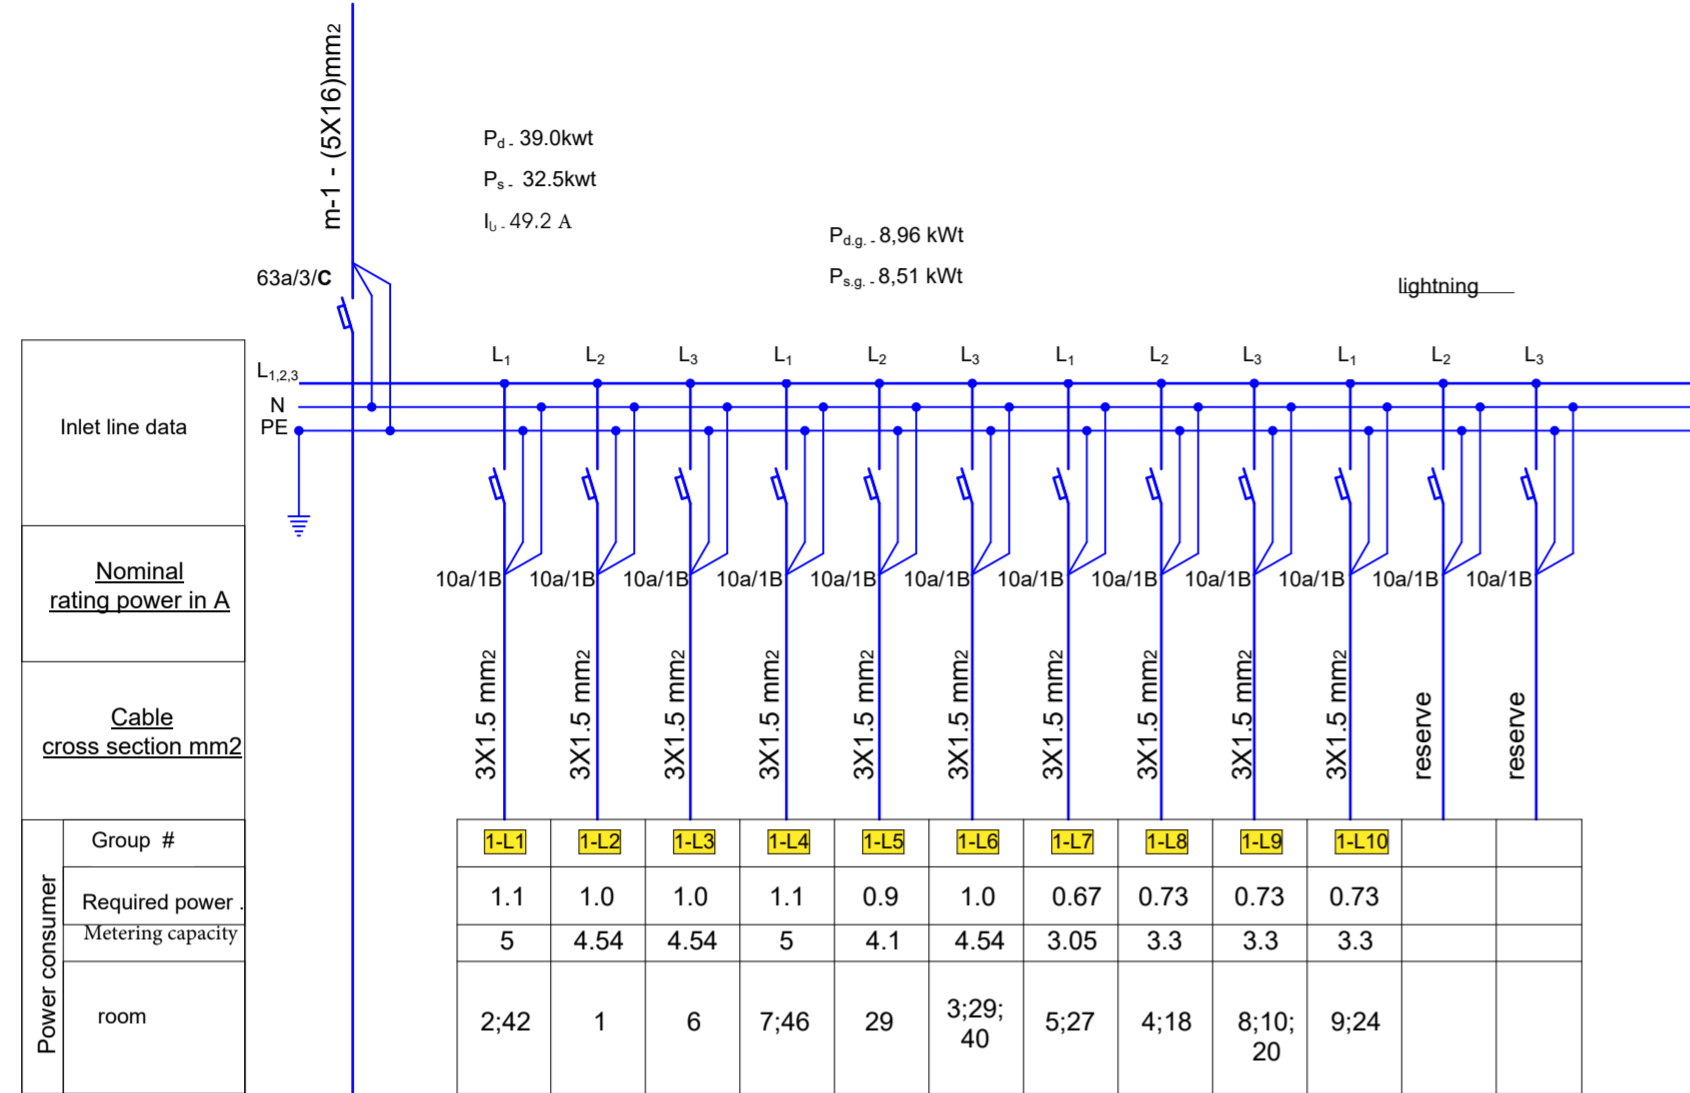

**Principal Plan of Distribution Box #2**

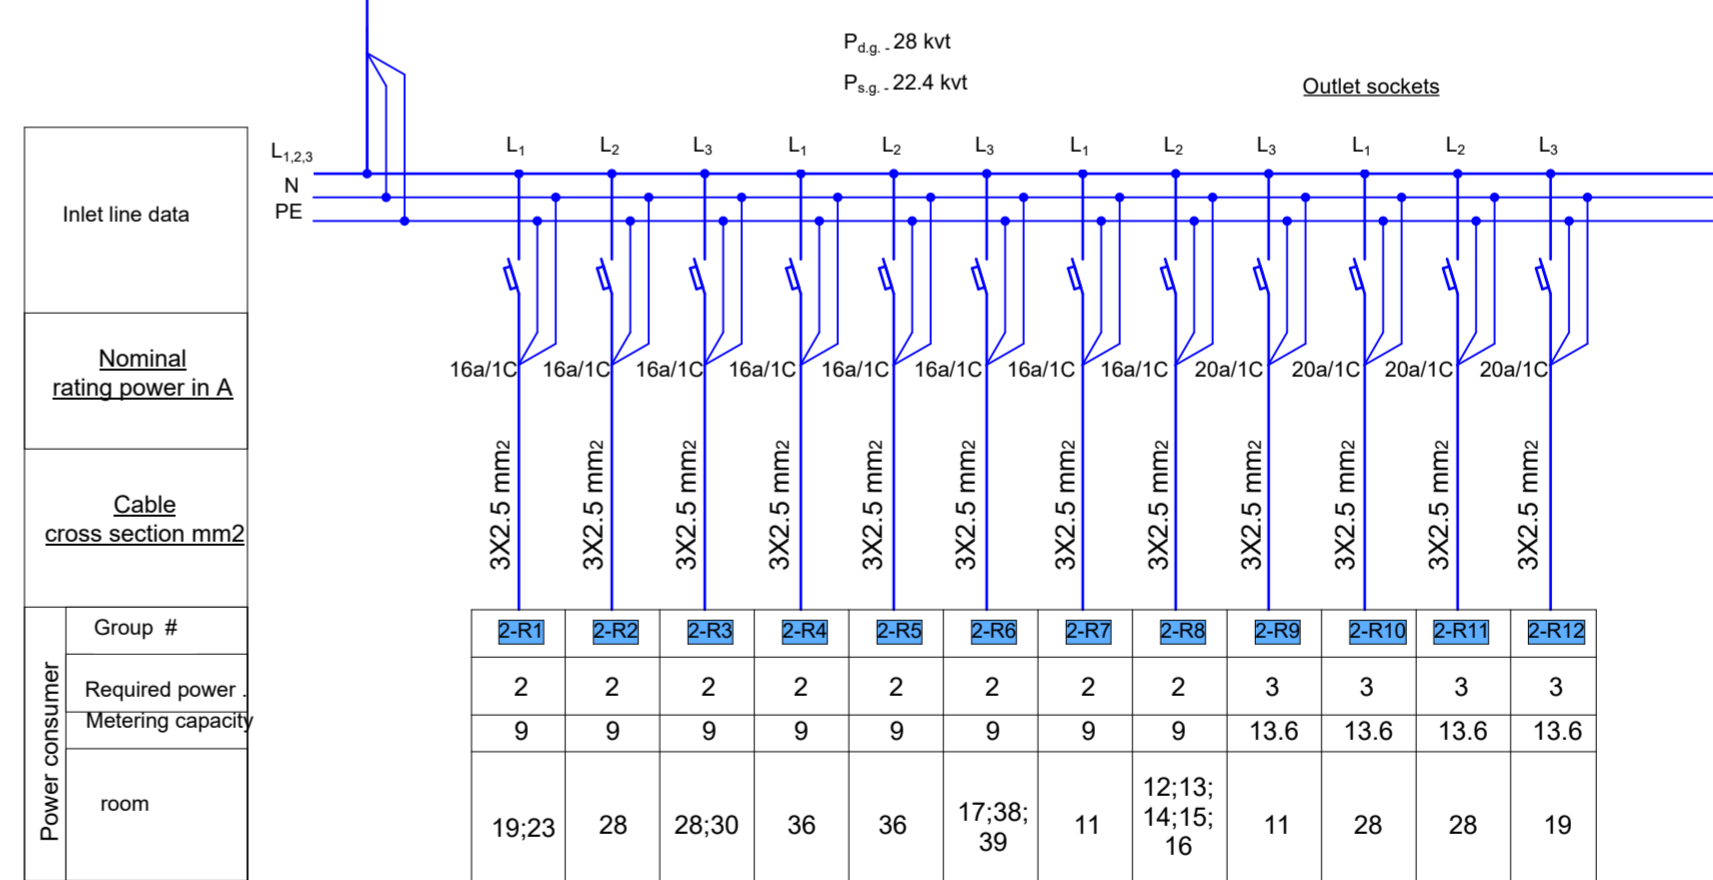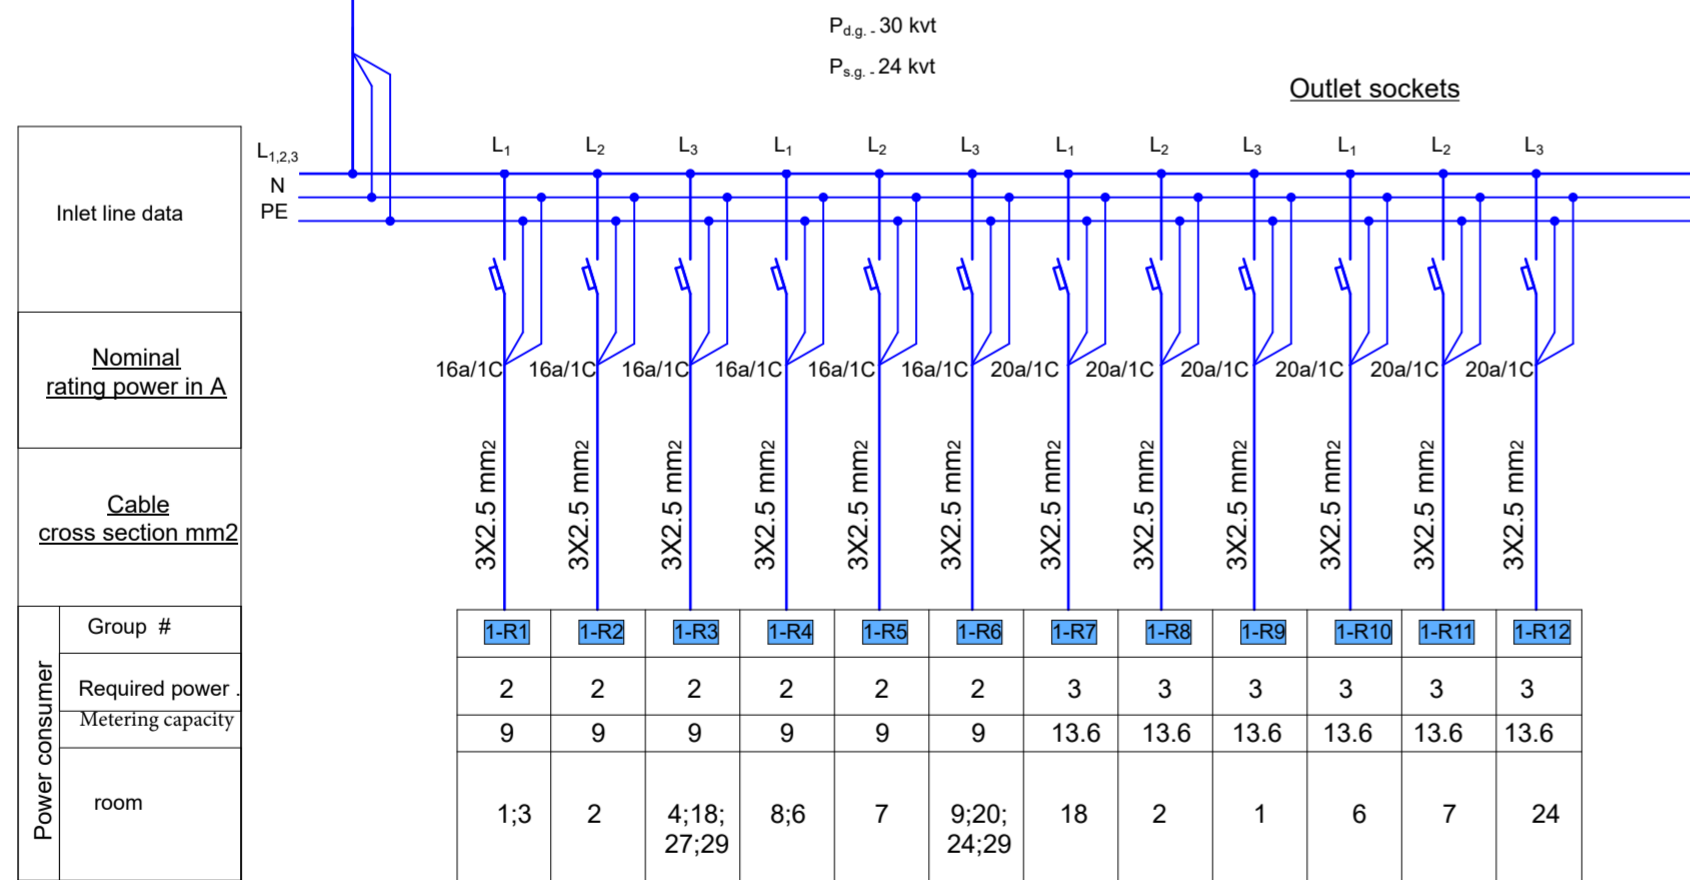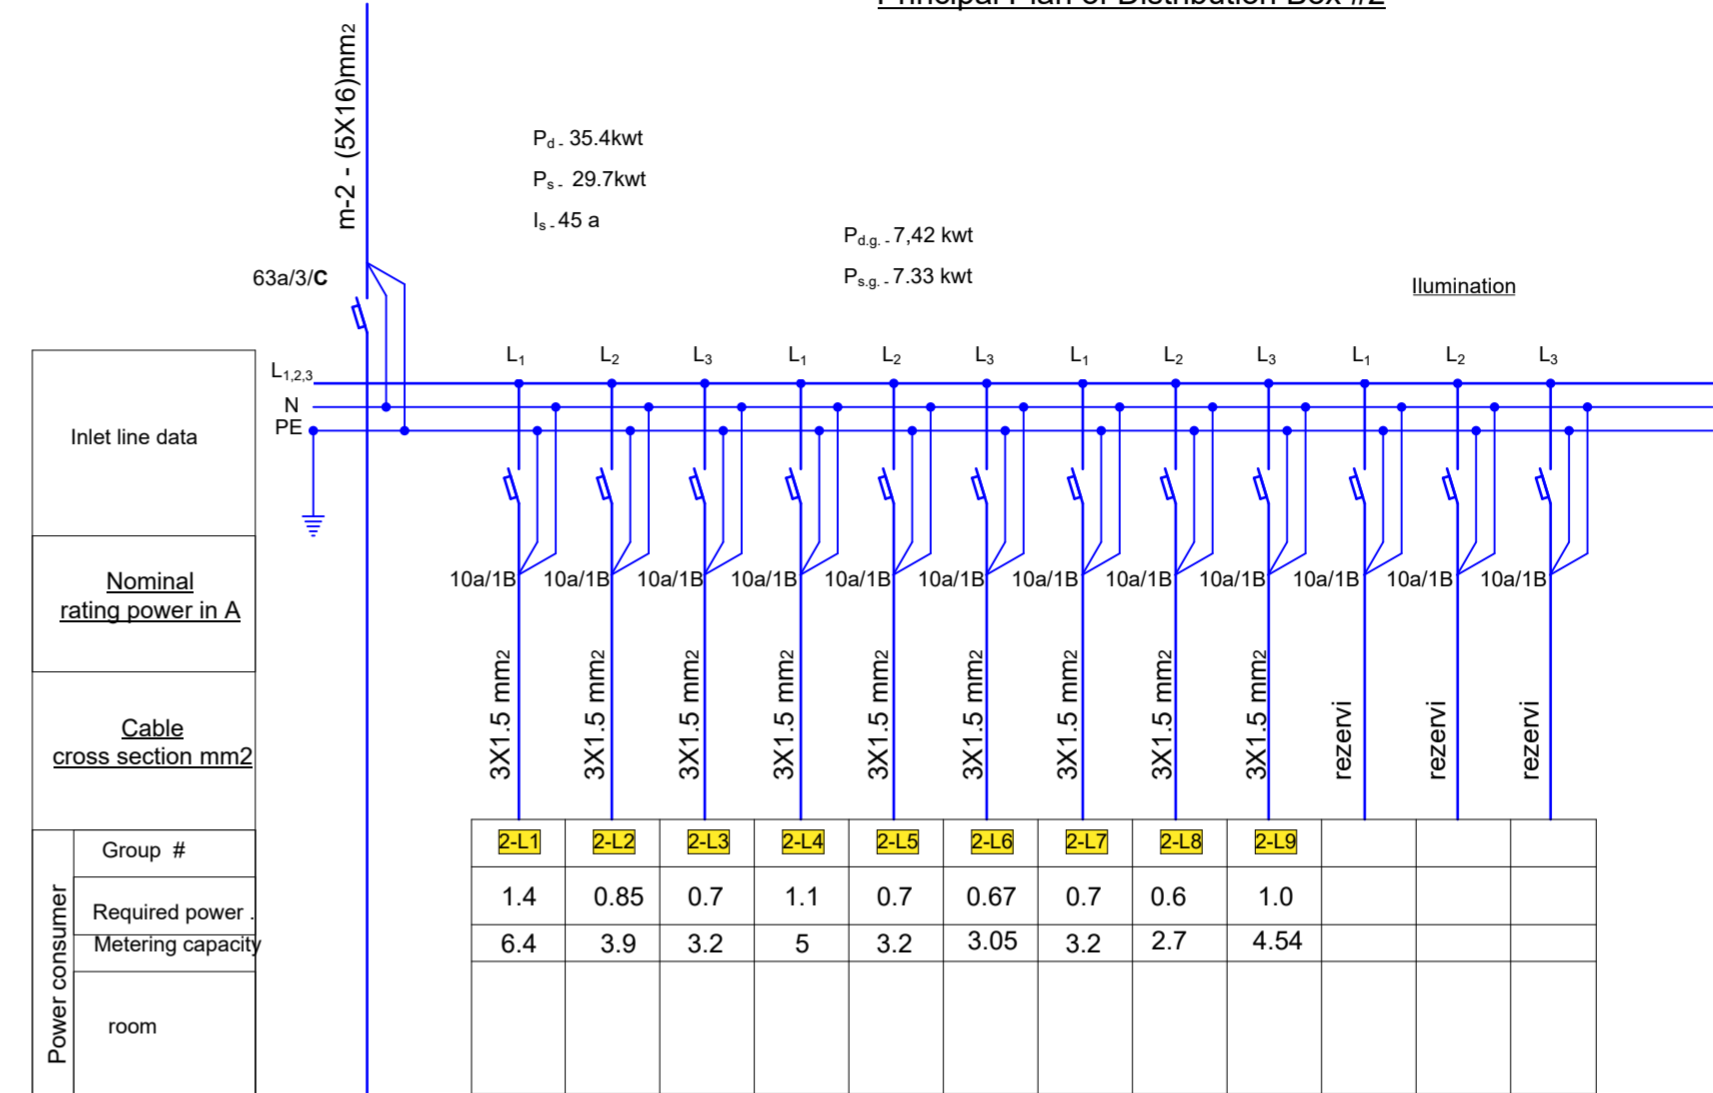

**Typical Kindergarten**


**Project address:**  
Georgia,

**Stage:**  
Architectural project

**Principal Pain of Distribution Shields**

ბ. ჯანთარია  
B. Qantaria

ა. გერგედავა  
A. Gergedava

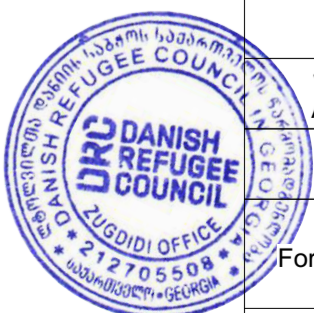

















Format A - 2

Plan of Electric Lighting System



Legend:

- |  |  |
|--|--|
|  Inlet distribution shield          |  Two-pole circuit breaker           |
|  Distribution shield                |  Two-pole circuit breaker air-tight |
|  Two-pole socket                    |  One-pole circuit breaker           |
|  One-pole socket                    |  One-pole circuit breaker air-tight |
|  Air-tight plug socket              |  LED lighting fixture for ceiling   |
|  Fan (for 100 mm pipe)              |  Spot lighting fixture for ceiling  |
|  Cooper cable 3X1.5mm <sup>2</sup>  |  LED lighting fixture air-tight     |
|  Separate group of lighting network |  Exit sign                          |

Typical Kindergarten


Project address:  
Georgia,

Stage:  
Architectural project

Plan of Electric Lighting System

ბ. ჯანთარია  
B. Qantaria


ა. გერგედავა  
A. Gergedava

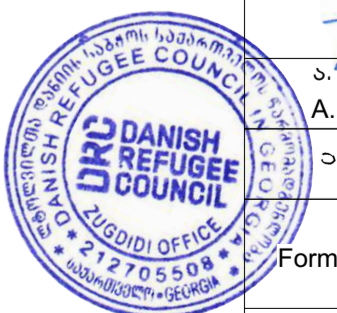







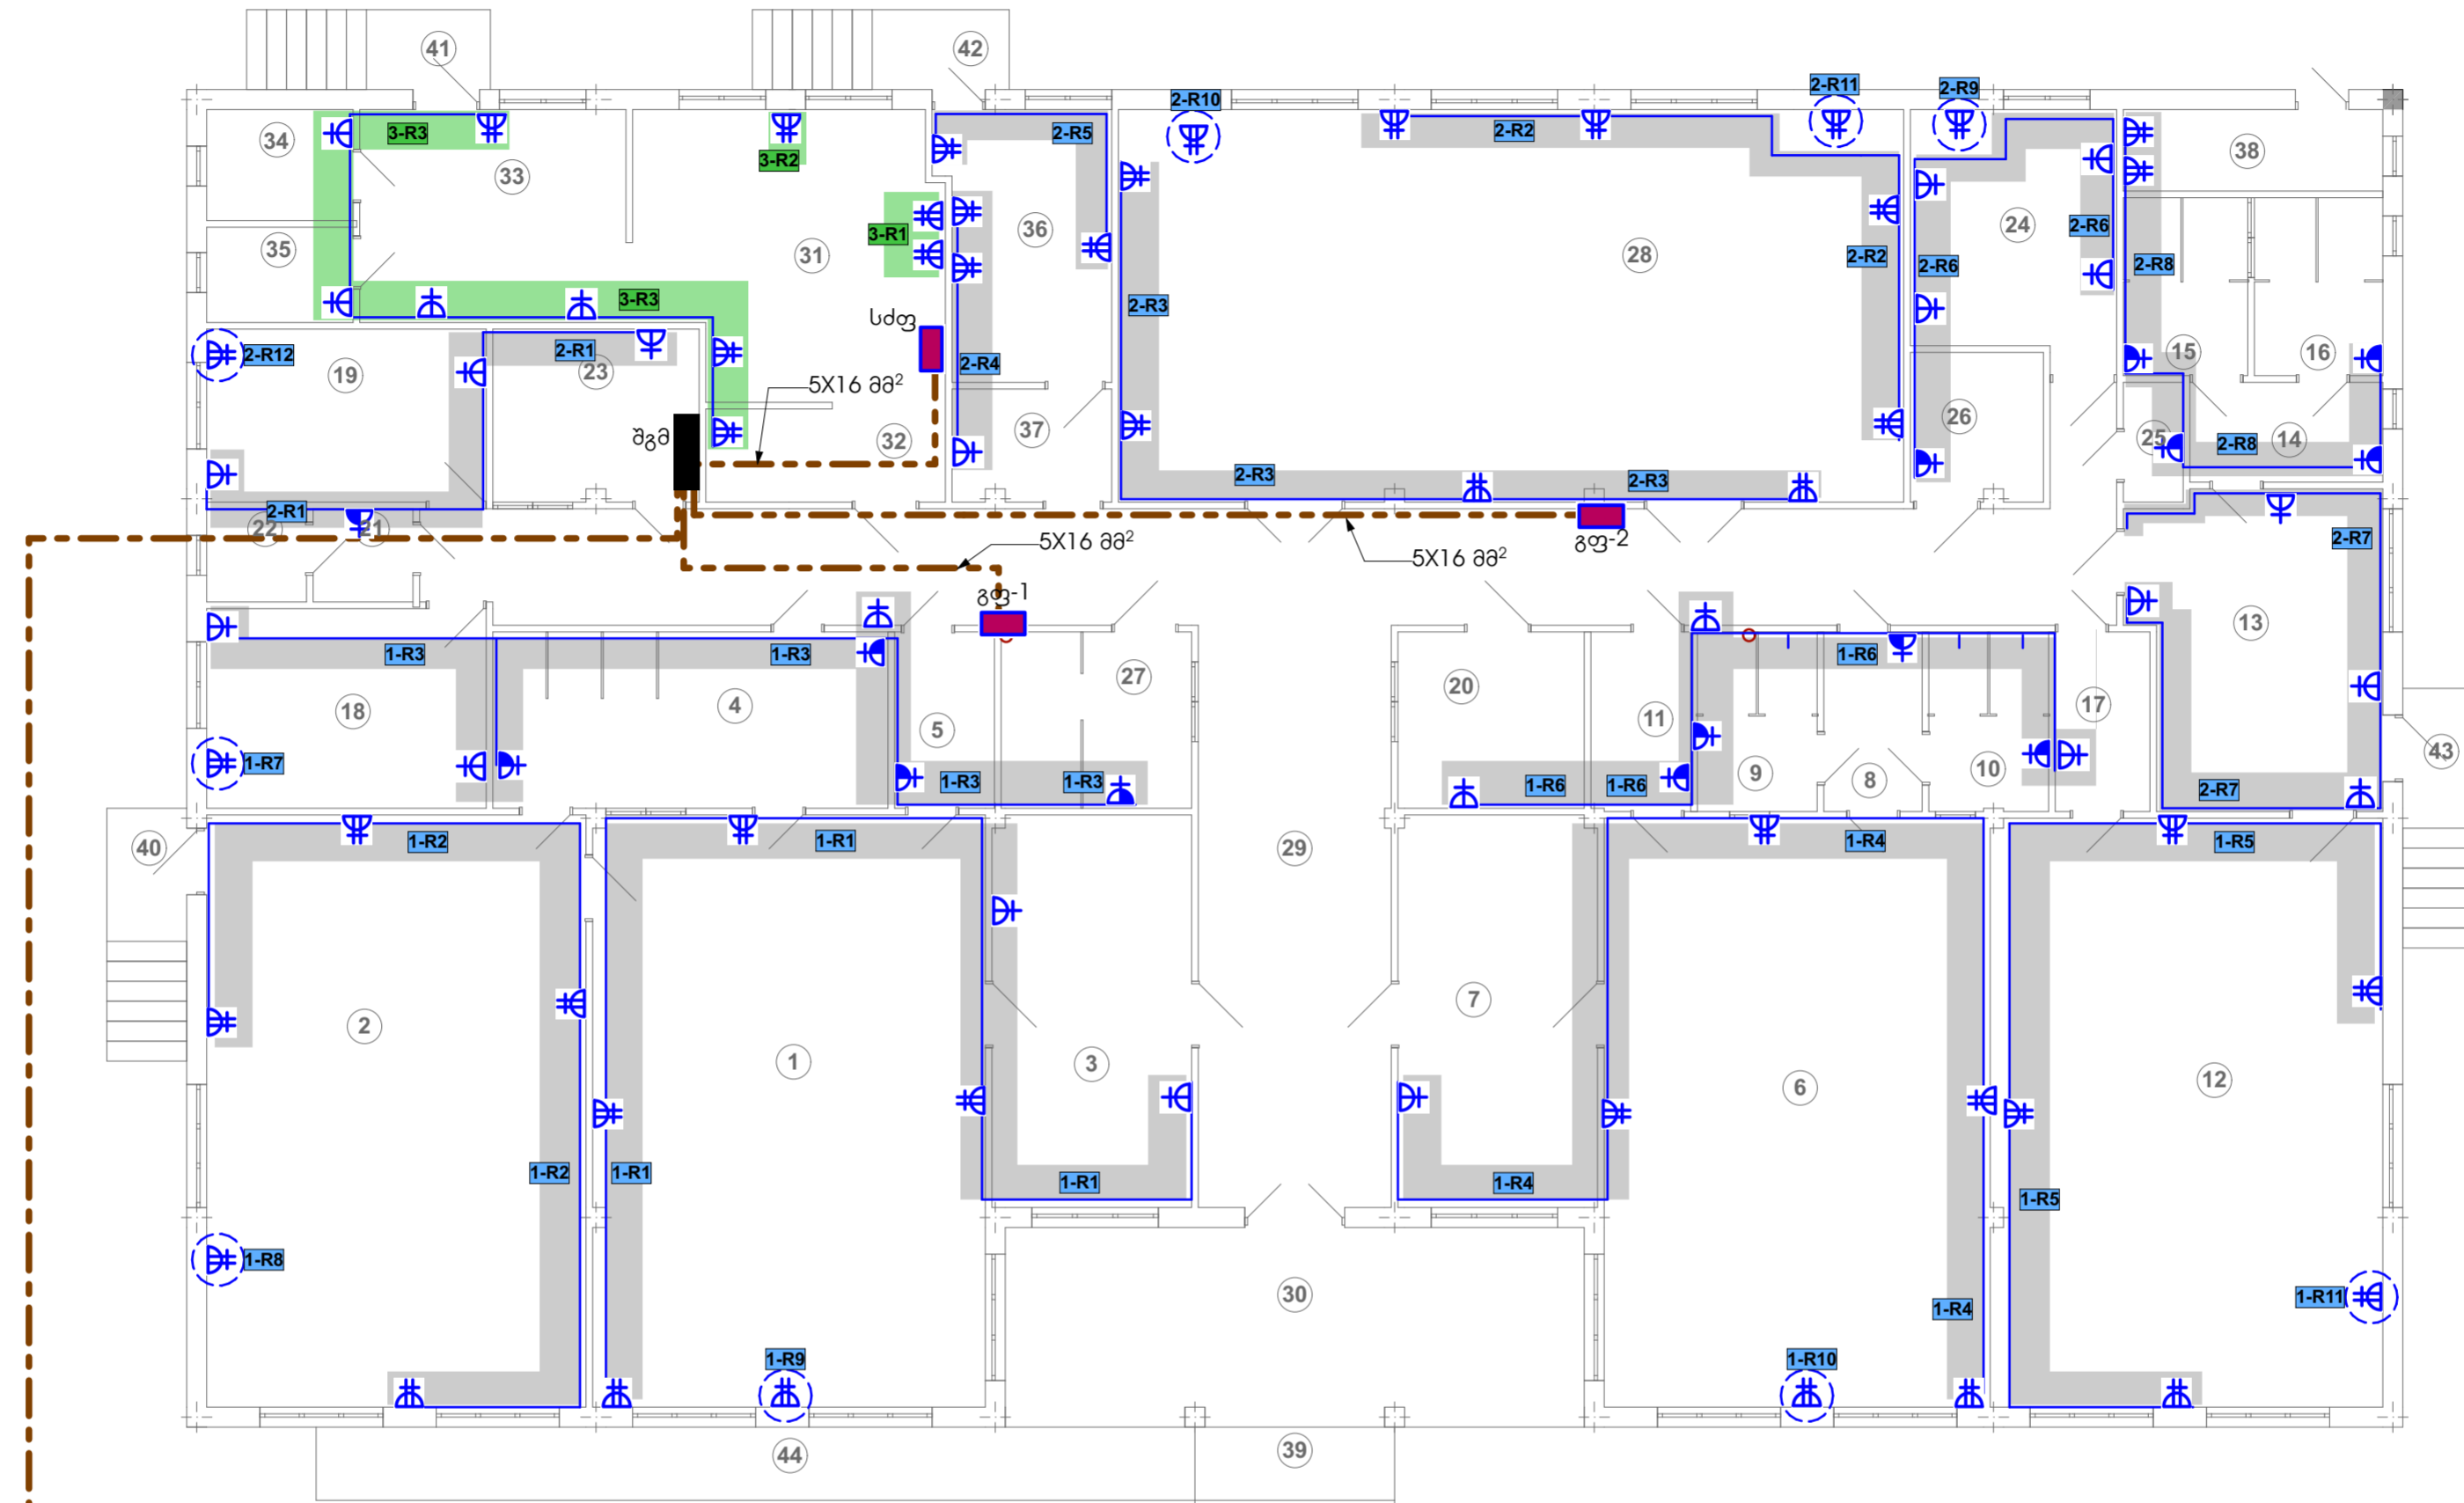


Format A - 2



Power Supply Plan of High-Power System



- Legends:
-  Inlet distribution shield
  -  Distribution shield
  -  Two-pole outlet socket
  -  Two-pole outlet socket for AC
  -  One-pole outlet socket
  -  Air-tight plug outlet socket
  -  Fan (for 100 mm pipe)
  -  Copper cable 3X1.5mm<sup>2</sup>
  -  Separate groups of high-power network

Typical Kindergarten


Project address:  
Georgia,

Stage:  
Architectural project

Power Supply  
Plan of High-  
Power System


ბ. ჯანთარია  
B. Qantaria

ა. გერგედავა  
A. Gergedava

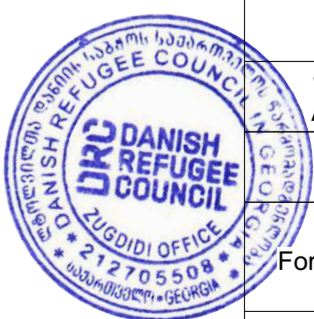

Format A - 2

**Fire Alarm System Plan**

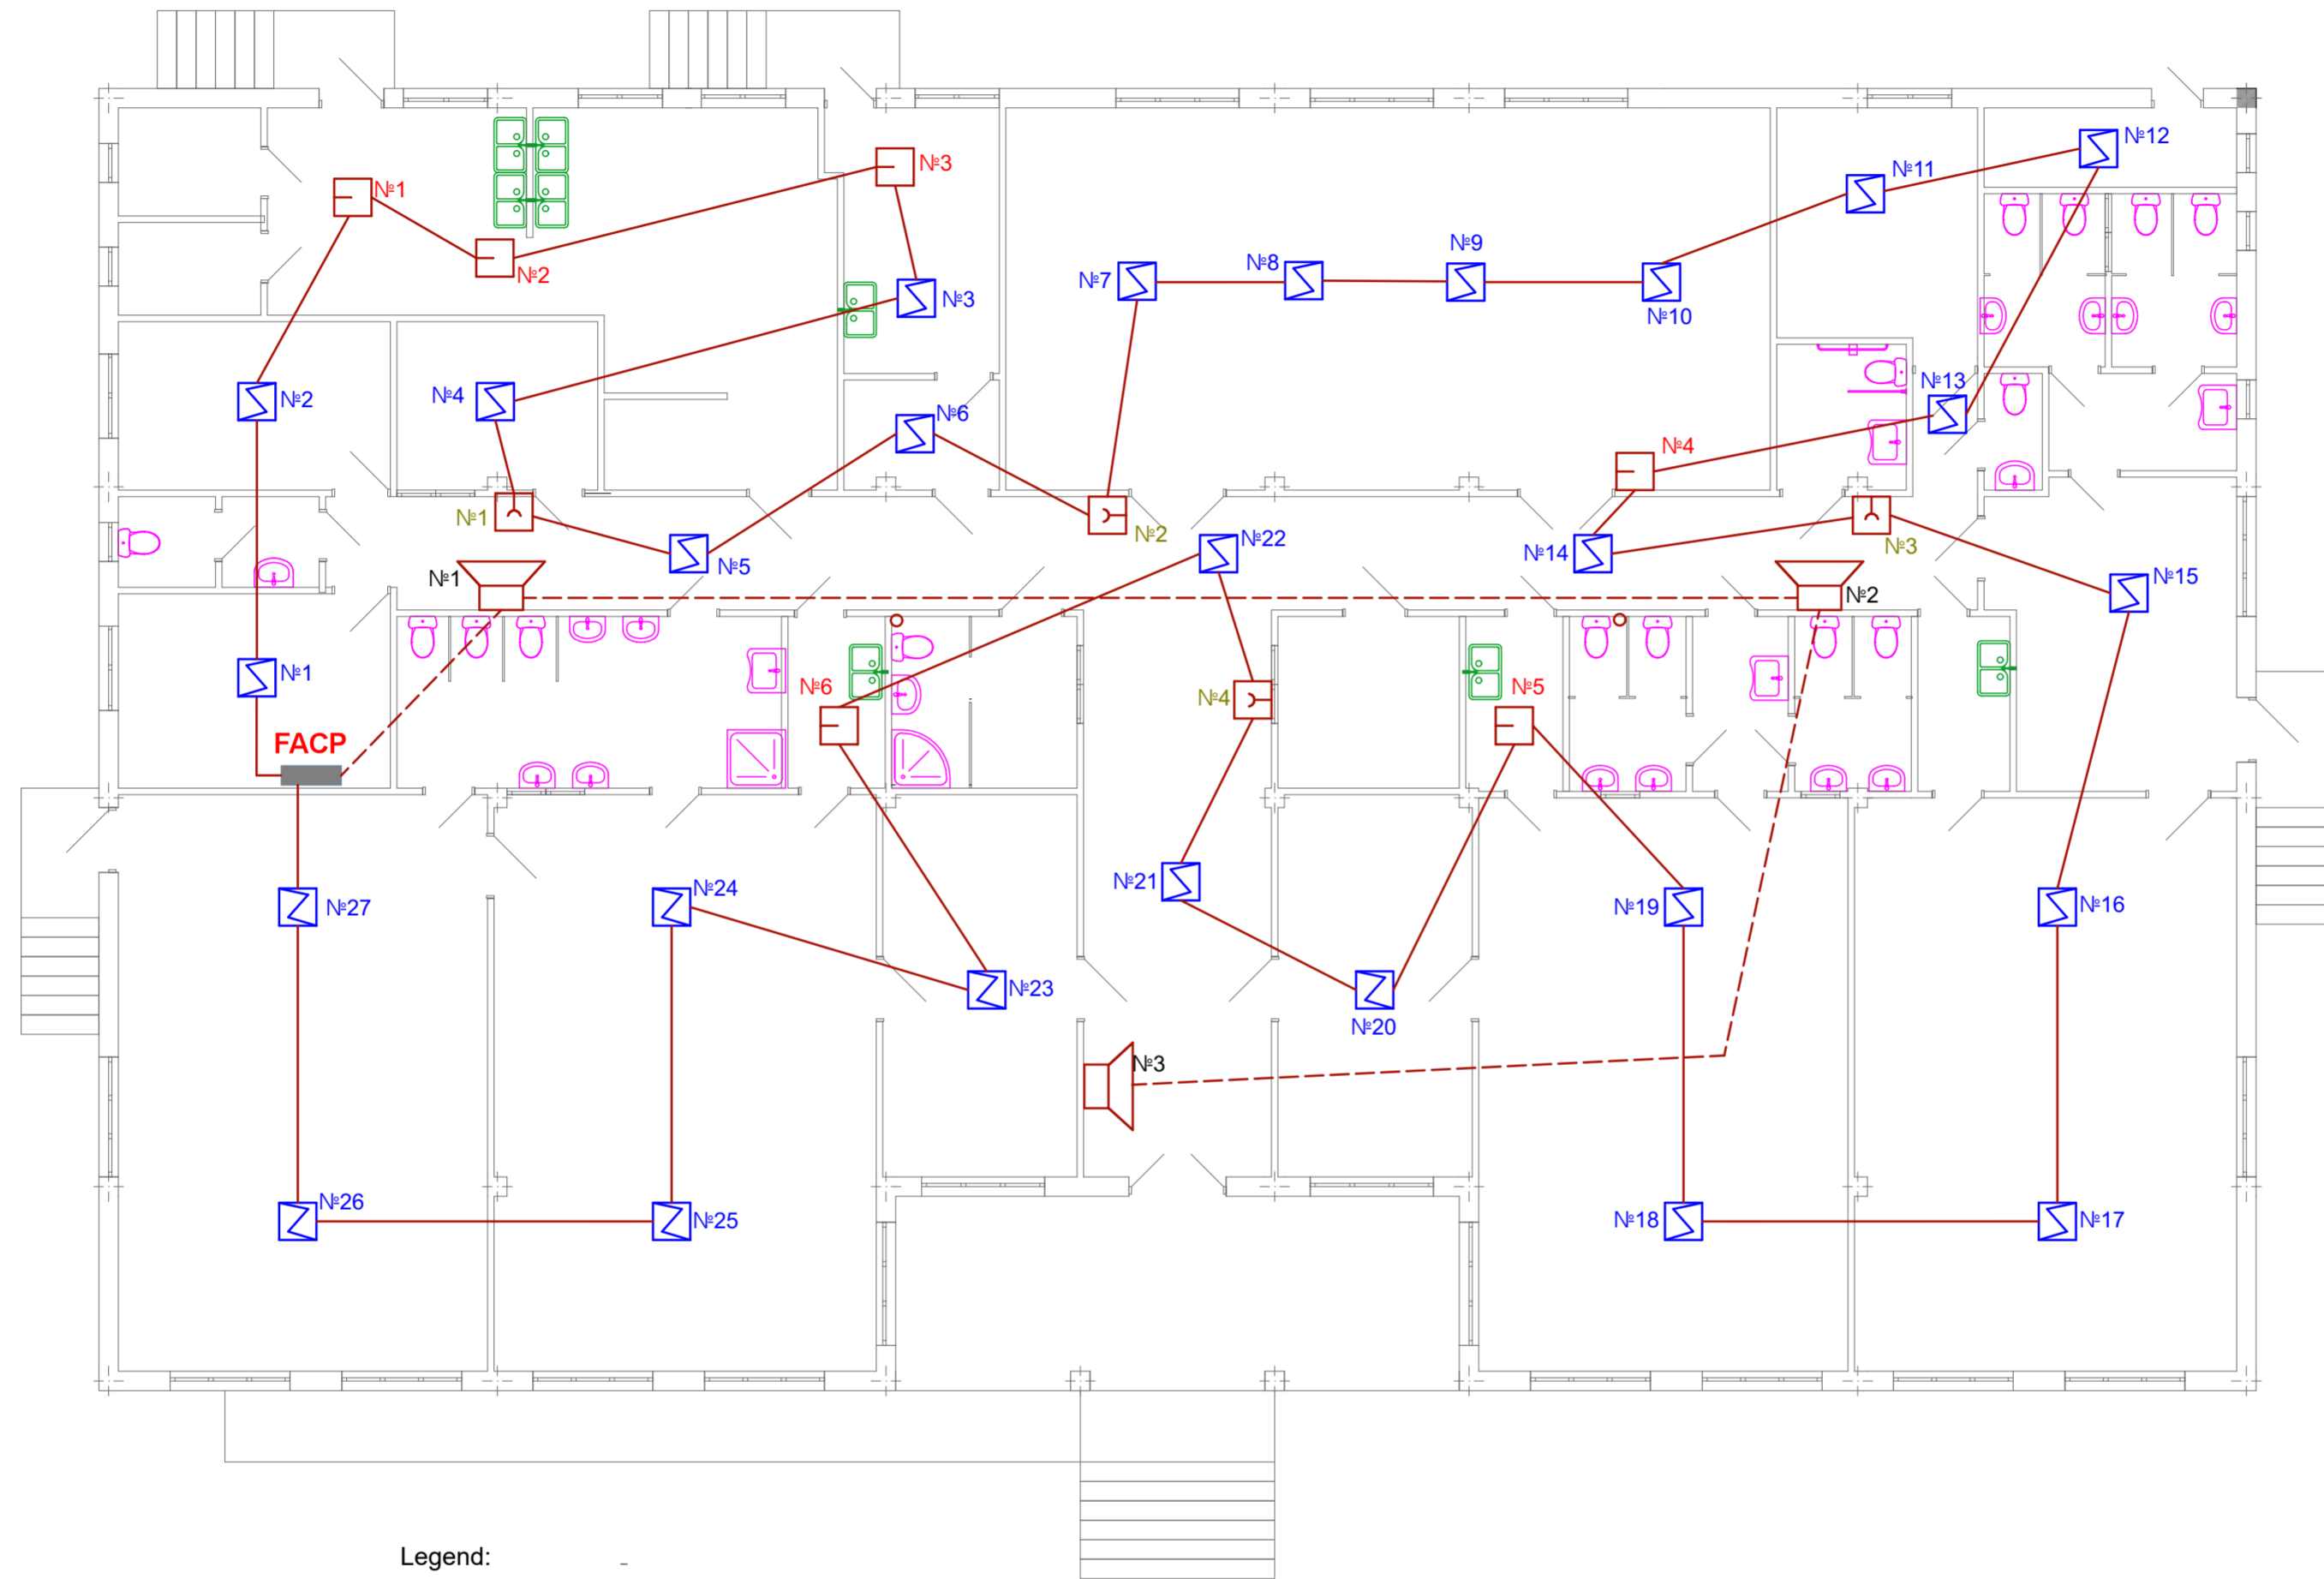

**Legend:**

- FACP    Addressable fire control panel
- Addressable optic smoke detector
- Addressable thermal detector
- Addressable alarm button
- Addressable alarm

**Typical Kindergarten**

Project address:  
Georgia,


Stage:  
Architectural project

Fire Alarm System Plan

ბ. ჯანთარია  
B. Qantaria

ა. გერგედავა  
A. Gergedava

ფორმატი  
Format    A - 2

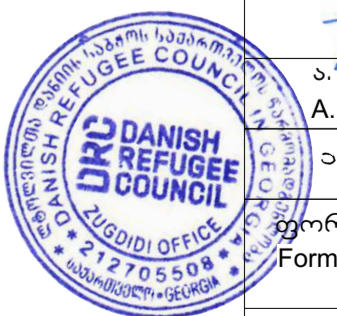

### Fire Alarm System

The fire alarm control panel must be installed on the ground floor level in the director's room. The project provides an addressable fire alarm system, the network of which is organized by a circular topology.

The fire extinguisher cable is built with a 2x2x0.8 mm 2 type fire proof cable and must be connected directly to the fire alarm panel.


Fire alarm, smoke, or combined fire detectors must be of the addressable type. Heat, smoke, or combined transmitters are be installed on the ceiling's geometric center (in the case of one broadcaster) or on a ceiling of an equally distributed control area.

Appropriate installation and schematic drawings are attached to the project. Alarm buttons are installed at all exits, at 1.8 m height from the floor. A fire alarm shall be mounted 0.3 m from the ceiling and shall give an alarm of not less than 100 dB / m 2.

Schematic drawing and design drawings of fire detectors, hand fire detectors and alarms are attached to the project.

Typical Kindergarten

Structural Diagram of the Fire Alarm System

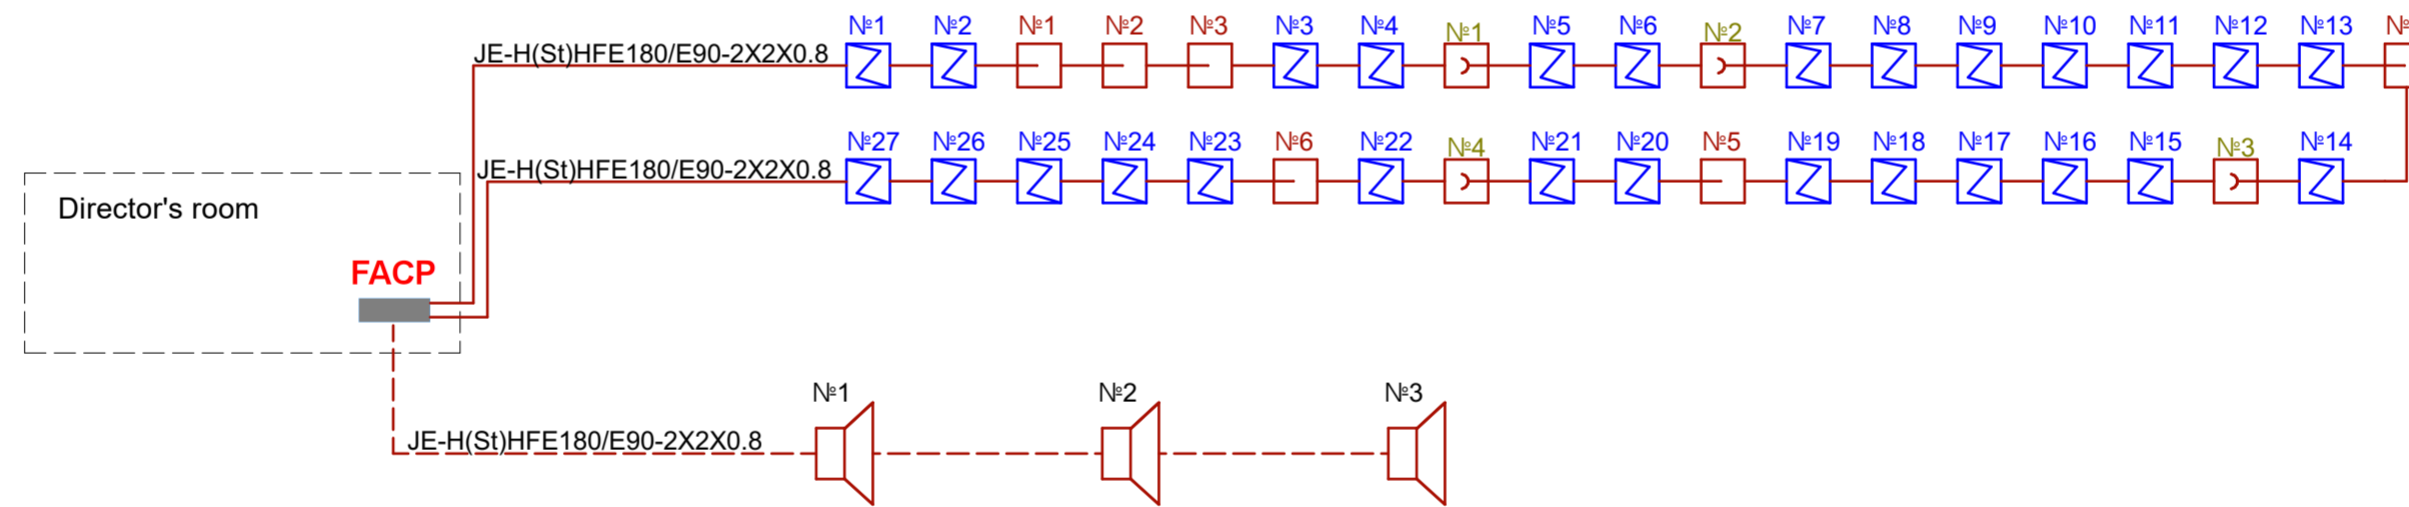

Fire Alarm System			
1	Fire proof cable JE-(St) H FE 180/E90 - 2X1X0.8	m	320
2	Addressble one loup fire control panel	set	1
3	Addressable smoke optic detector	pcs	27
4	Addressable thermal detector	pcs	6
5	Universal addressable base	pcs	33
6	Addressable alarm button	pcs	4
7	Addressable alarm	pcs	3
8	Power supply unit	pcs	1


Project address:  
Georgia,

Stage:  
Architectural project

Structural  
Diagram of the  
Fire Alarm  
System

ბ. ჯანთარია  
B. Qantaria

ა. გერგედავა  
A. Gergedava

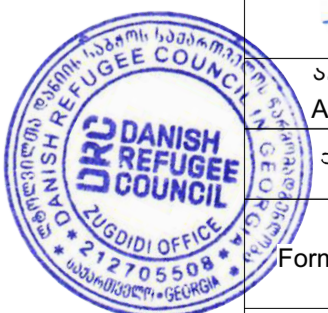

Format A - 2